


A NEW BATHROOM AT NORTH ALBANY PARK

BENTON COUNTY PARKS 2800 HILLCREST ST., NW ALBANY, OR



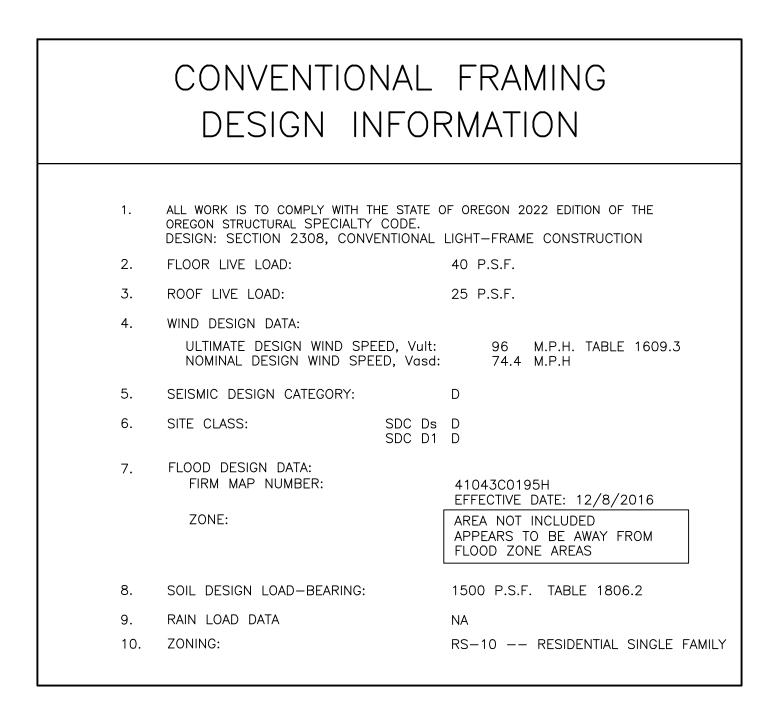


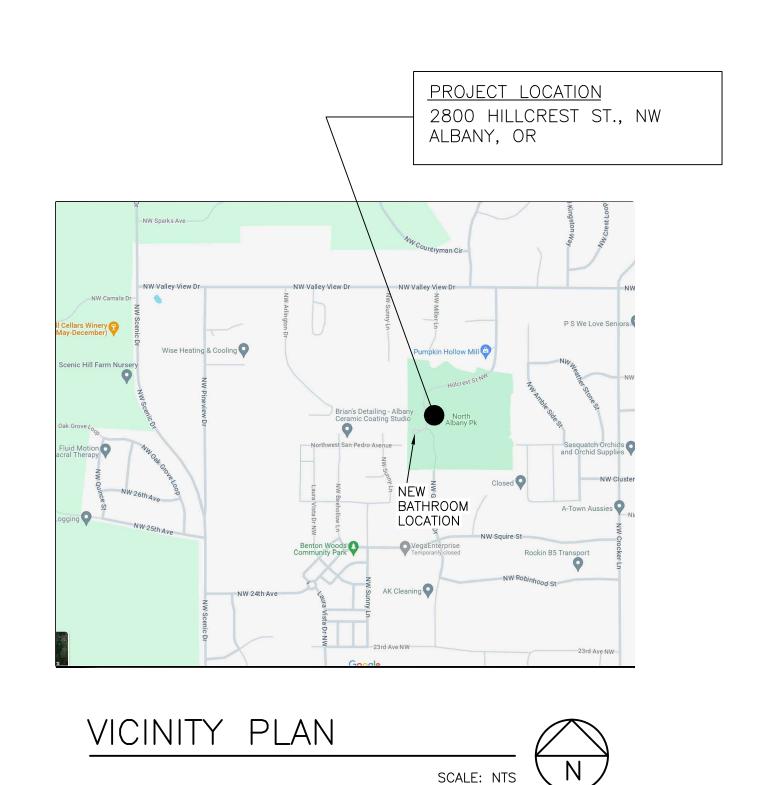

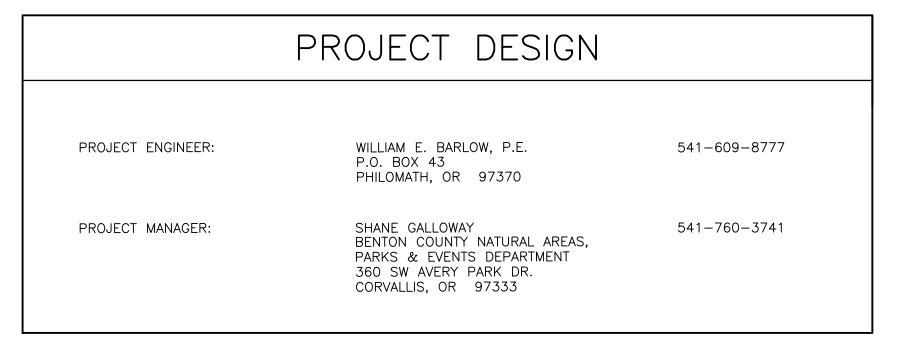


SQUARE FOOTAGE

BATHROOM BUILDING: 520 SF

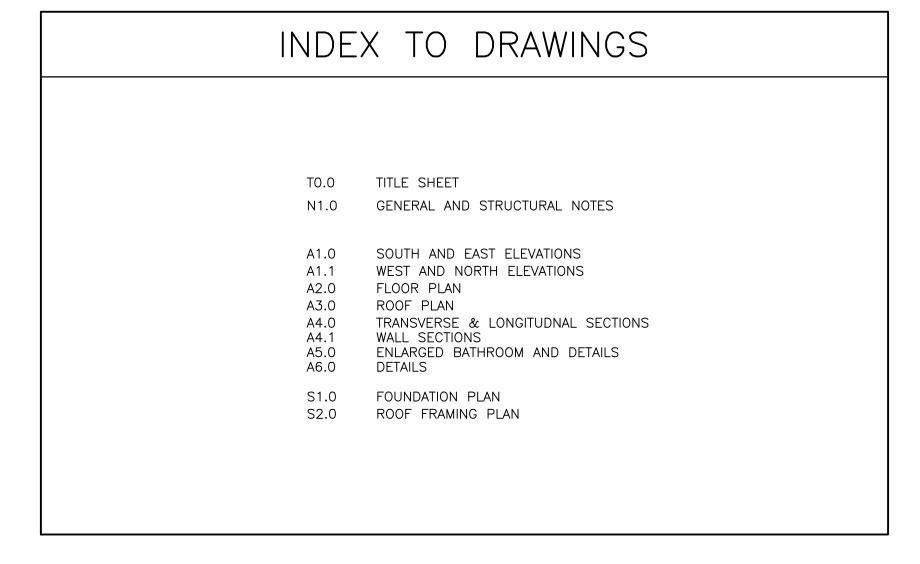

NOTES

- THE CONTRACTOR SHALL ENSURE THAT CONSTRUCTION MEANS AND METHODS, INCLUDING LOADING AND BRACING, SHALL NOT EXCEED THE CAPACITY OF STRUCTURAL MEMBERS.
- MECHANICAL (HVAC), ELECTRICAL, PLUMBING DESIGN BY OTHERS.



VIL ENGINEERING DESIGN
ign for the Human Environment
LIAM E. BARLOW, P.E.
PONATH, OR 97370

DATE 12.20.2023

SCALE AS SHOWN

DRAWN WEB

T0.0

SHEET

STRUCTURAL NOTES

<u>GENERAL</u>

- 1. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION. THE ENGINEERS SHALL BE NOTIFIED OF ANY DISCREPANCIES OR INCONSISTENCIES.
- 2. DO NOT SCALE DRAWINGS. COORDINATE DIMENSIONS WITH "A" DESIGN DRAWINGS. COORDINATE CONSTRUCTION WITH ALL TRADES.
- 3. ALL WORK SHALL CONFORM TO THE MINIMUM STANDARDS OF 2022 OREGON STRUCTURAL SPECIALTY CODE ADOPTED BY THE STATE OF OREGON.
- 4. METHODS, PROCEDURES, AND SEQUENCES OF CONSTRUCTION ARE THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO MAINTAIN AND ENSURE THE INTEGRITY OF THE STRUCTURE AT ALL STAGES OF
- 5. THE STRUCTURAL DRAWINGS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCITON. THE CONTRACTOR SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE, WORKERS, AND VISITORS DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE, BUT NOT LIMITED TO BRACING, SHORING FOR CONSTRUCTION LOADS, ETC. VISITS TO THE SITE BY THE PROJECT ENGINEER OR HIS AGENT OR REPRESENTATIVE, SHALL NOT INCLUDE REVIEW OF THE ABOVE ITEMS.
- 6. OPENINGS, POCKETS, ETC. SHALL NOT BE PLACED IN STRUCTURAL ELEMENTS UNLESS SPECIFICALLY DETAILED OR APPROVED BY THE PROJECT ENGINEER WHOSE NAME AND SEAL (STAMP) APPEAR ON THESE STRUCTURAL DRAWINGS.
- 7. CONSTRUCTION LOADS (MATERIAL AND EQUIPMENT) SHALL NOT EXCEED THE DESIGN LIVE LOAD PER SQUARE FOOT. PROVIDE ADEQUATE SHORING AND/OR BRACING WHERE THE STRUCTURE HAS NOT ATTAINED DESIGN STRENGTH.
- 8, WHEN A DETAIL IS IDENTIFIED AS TYPICAL, THE CONTRACTOR SHALL APPLY THIS DETAIL IN ESTIMATING AND CONSTRUCTION TO EVERY LIKE CONDITION WHETHER OR NOT THE REFERENCE IS MADE IN EVERY INSTANCE.

MECHANICAL

1. MECHANICAL HVAC BY OTHERS.

ELECTRICAL

1. ELECTRICAL BY OTHERS.

PLUMBING

PLUMBING BY OTHERS.

<u>FOUNDATION</u>

- 1. FOUNDATION SOIL BEARING PRESSURE ASSUMED TO BE 1000 PSI.
- 2. THE CONTRACTOR SHALL PROVIDE FOR DE-WATERING OF EXCAVATIONS FOR EITHER SURFACE, GROUND, OR SEEPAGE WATER.
- 3. ANY ABANDONED MATERIALS, FOOTINGS, UTILITIES, ETC., THAT INTERFERE WITH NEW CONSTRUCTION SHALL BE REMOVED.
- 4. THE CONTRACTOR SHALL PROVIDE FOR DESIGN AND INSTALLATION OF ALL CRIBBING, SHEATHING, AND SHORING REQUIRED TO SAFELY RETAIN THE EARTH BANKS.

DIMENSIONAL LUMBER

1. DIMENSIONAL LUMBER FOR FRAMING SHALL BE DOUGLAS FIR - LARCH (DF-L) No. 2 OR BETTER.

ROOF TRUSSES

1. TRUSSES SHALL BE DESIGNED AND STAMPED BY AN ENGINEER IN THE STATE OF

SIMPSON STRONG-TIE

1. INSTALL SIMPSON PRODUCTS PER MANUFACTURERS INSTRUCTIONS. (CATALOG C-C-2021)

CONCRETE AND REINFORCEMENT

- 1. MAX. AGGREGATE SIZE IS 3/4 INCH. MIX DESIGNS SHALL BE SIGNED BY AN ENGINEER LICENSED IN THE STATE OF THE OREGON.
- 2. AGGREGATE FOR NORMAL WEIGHT CONCRETE SHALL CONFORM TO ASTM C33. PORTLAND CEMENT SHALL BE TYPE I OR TYPE II AND SHALL CONFORM TO
- 3. ADMIXTURES MAY BE USED WITH PRIOR APPROVAL OF THE PROJECT ENGINEER. ADMIXTURES USED TO INCREASE THE WORKABILITY OF THE CONCRETE SHALL NOT BE CONSIDERED TO REDUCE THE SPECIFIED MINIMUM CEMENT CONTENT. CALCIUM CHLORIDE SHALL NOT BE USED.
- 4. COMPRESSIVE STRENGTHS OF CONCRETE AT 28 DAYS SHALL BE AS FOLLOWS:
- 5. MIXING, TRANSPORTING, AND PLACING OF CONCRETE SHALL CONFORM TO ACI 304R. ALL CONCRETE SURFACES AGAINST WHICH CONCRETE IS TO BE PLACED SHALL BE THOROUGHLY CLEANED. LAITANCE AND STANDING WATER SHALL BE
- 6. ALL REINFORCING BARS, ANCHOR BOLTS, AND OTHER CONCRETE CONNCECTORS SHALL BE WELL SECURED IN POSITION PRIOR TO PLACING CONCRETE, PROVIDE CONCRETE PROTECTION AS REQUIRED AND NECESSARY.
- 7. CONCRETE COVER PROTECTION FOR REINFORCEMENT BAR SHALL BE AS FOLLOWS: (SEE ACI 318-02 FOR CONDITIONS NOT NOTED.) 8.1 CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH
- 8. REINFORCING STEEL (REBAR) FOR CONCRETE SHALL BE DEFORMED, GRADE 60 (fy=60000 PSI YEILD STRENGTH). A615
- 9. DETAILING OF CONCRETE REINFORCEMENT BARS AND ACCESSORIES SHALL CONFORM TO THE RECOMMENDATIONS OF THE AMERICAN CONCRETE INSTITUTE (ACI) DETAILING MANUAL, ACI COMMITTEE 315.
- 10. GROUT SHALL BE NON-SHINKABLE GROUT CONFORMING TO ASTM C827 AND SHALL HAVE A SPECIFIED COMPRESSIVE STRENGTH AT 28 DAYS OF 5000 psi. PREGROUTING OF BASE PLATES WILL NO BE PERMITTED.
- 11. STEEL WELDED WIRE REINFORCEMENT (WWR) 11.1 ASTM A185, PLAIN TYPE IN ROLLS, PLÁIN FINISH. PROVIDE 6"x6"-W1.4xW1.4 WWF. GRADE 65 MIN. (65000 PSI YIELD)
- 12. BAR AND WELDED WIRE REINFORCEMENT SUPPORTS
 - 12.1 PROVIDE ALL SPACERS, CHAIRS (HCM), TIES AND OTHER DEVICES NECESSARY TO PLACE, SPACE, SUPPORT AND MAINTAIN REBAR AND/OR WWR IN LOCATIONS IN
 - 12.2 CONFORM TO "BAR SUPPORT SPECIFICATION," CRSI MANUAL OF STANDARD PRACTICE, CHAPTER 3, LATEST EDITION, AND BE OF THE FOLLOWING TYPES: 12.2.1 SUPPORT REINFORCING IN FOOTINGS WITH PRECAST CONCRETE BLOCKS. 12.2.2 SUPPORT FOR WWR IN SLABS WITH PRECAST CONCRETE BLOCKS OR METAL CHAIRS OF ACI TYPE HCM, CLASS 3.
- 13. CONCRETE RETAINING WALL SHALL BE CONSOLIDATED USING A MECHANICAL VIBRATION SYSTEM. 13.1 4'-0" MAXIMUM LIFT HEIGHT

GENERAL NOTES

GENERAL

- 1. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS BEFORE CONSTRUCITON. THE ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCIES OR INCONSISTENCIES.
- 2. DO NOT SCALE DRAWINGS.

- 1. EXTERIOR SIDING SHALL BE HARDIE ARCHITECTURAL COLLECTION OR PROJECT MANAGER APPROVED EQUAL:
- 1.1 STYLE: MOUNDED SAND SIDING 1.2 THICKNESS: 0.312"

GROUNDING ELECTRODES

1. IF CONTRETE REINFORCING BAR IS USED AS A GROUNDING ELECTRODE, USED UNCOATED #4 REINFORCING BAR INSTALLED NOT LESS THAN 3 INCHES FROM THE BOTTOM OF THE FOOTING AND NOT LESS THAN 20 FEET IN LENGTH ENCASED WITH A MINIMUM OF 2 INCHES OF CONCRETE.

WEATHER PROTECTION

- 1. FLASHING SHALL BE INSTALLED IN SUCH A MANNER SO AS TO PREVENT MOISTURE ENTERING THE WALLS AND ROOF THROUGH JOINTS IN COPINGS, THROUGH MOISTURE PERMEABLE MATERIALS, AND AT VERTICAL WALLS AND ROOF INTERSECTIONS AND OTHER PENETRATIONS THROUGH THE WALL AND ROOF PLANES.
- 2. METAL FLASHING SHALL BE CORROSION RESISTANT WITH A THICKNESS OF NOT LESS THAN 0.019 INCHES.
- 3. FLASHING AGAINST A VERTIAL SIDEWALL SHALL BE BY THE STEP-FLASHING METHOD.
- 4. FLASHING AGAINST A VERTICAL FRONT WALL, AS WELL AS SOIL STACK AND VENT PIPE SHALL BE APPLIED ACCORDING TO ASPHALT SHINGLE MFG'S PRINTED INSTRUCTIONS.
- 5. CORROSION-RESISTIVE FLASHING SHALL BE PROVIDED IN THE EXTERIOR WALL ENVELOPE IN SUCH A MANNER AS TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATIONS OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS. THE FLASHING SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH AND SHALL BE INSTALL TO PREVENT WATER FROM REENTERING THE EXTERIOR WALL ENVELOPE.

MISCELLANEOUS


1. FASTENERS PENETRATING ALL PRESSURE PRESERVATIVE AND FIRE RETARDANT TREATED WOOD SHALL BE OF HOT DIPPED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE, OR COPPER. EXCEPTION: 1/2" DIAMETER OR GREATER STEEL BOLTS.

PAINT (FOR COLOR SEE PROJECT MANAGER)

- SHERWIN-WILLIAMS PRO INDUSTRIAL WATER BASED CATALYZED EPOXY EG-SHEL, B73-300 SERIES
- BATHROOM FLOORS & MECHANICAL ROOM FLOORS SHERWIN-WILLIAMS ARMORSEAL 8100 FINISH, B70-8160 SERIES
- EXTERIOR WALLS
- SHERWIN-WILLIAMS A-100 EXTERIOR LATEX LOW SHEEN, A12 SERIES
- MECHANICAL ROOM WALLS SHERWIN-WILLIAMS PRO INDUSTRIAL WATER BASED CATALYZED EPOXY GLOSS
- SHERWIN-WILLIAMS SNAPDRY DOOR & TRIM PAINT

JAMES HARDIE MATERIAL

1. INSTALL JAMES HARDIE MATERIAL IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.




000

REVISIONS

ABBREVIATIONS EXISTING CONTINUOUS NEW MAX. MAXIMUM **TYPICAL** CENTER LINE CL FRP ON CENTER FIBER REINFORCED SQUARE FEET PLASTIC OVER HANG OPNG OPENING PLY'D PLYWOOD GYP. BD. GYPSUM BOARD DOUBLE


DATE 12.20.2023 SCALE AS SHOWN DRAWN WEB

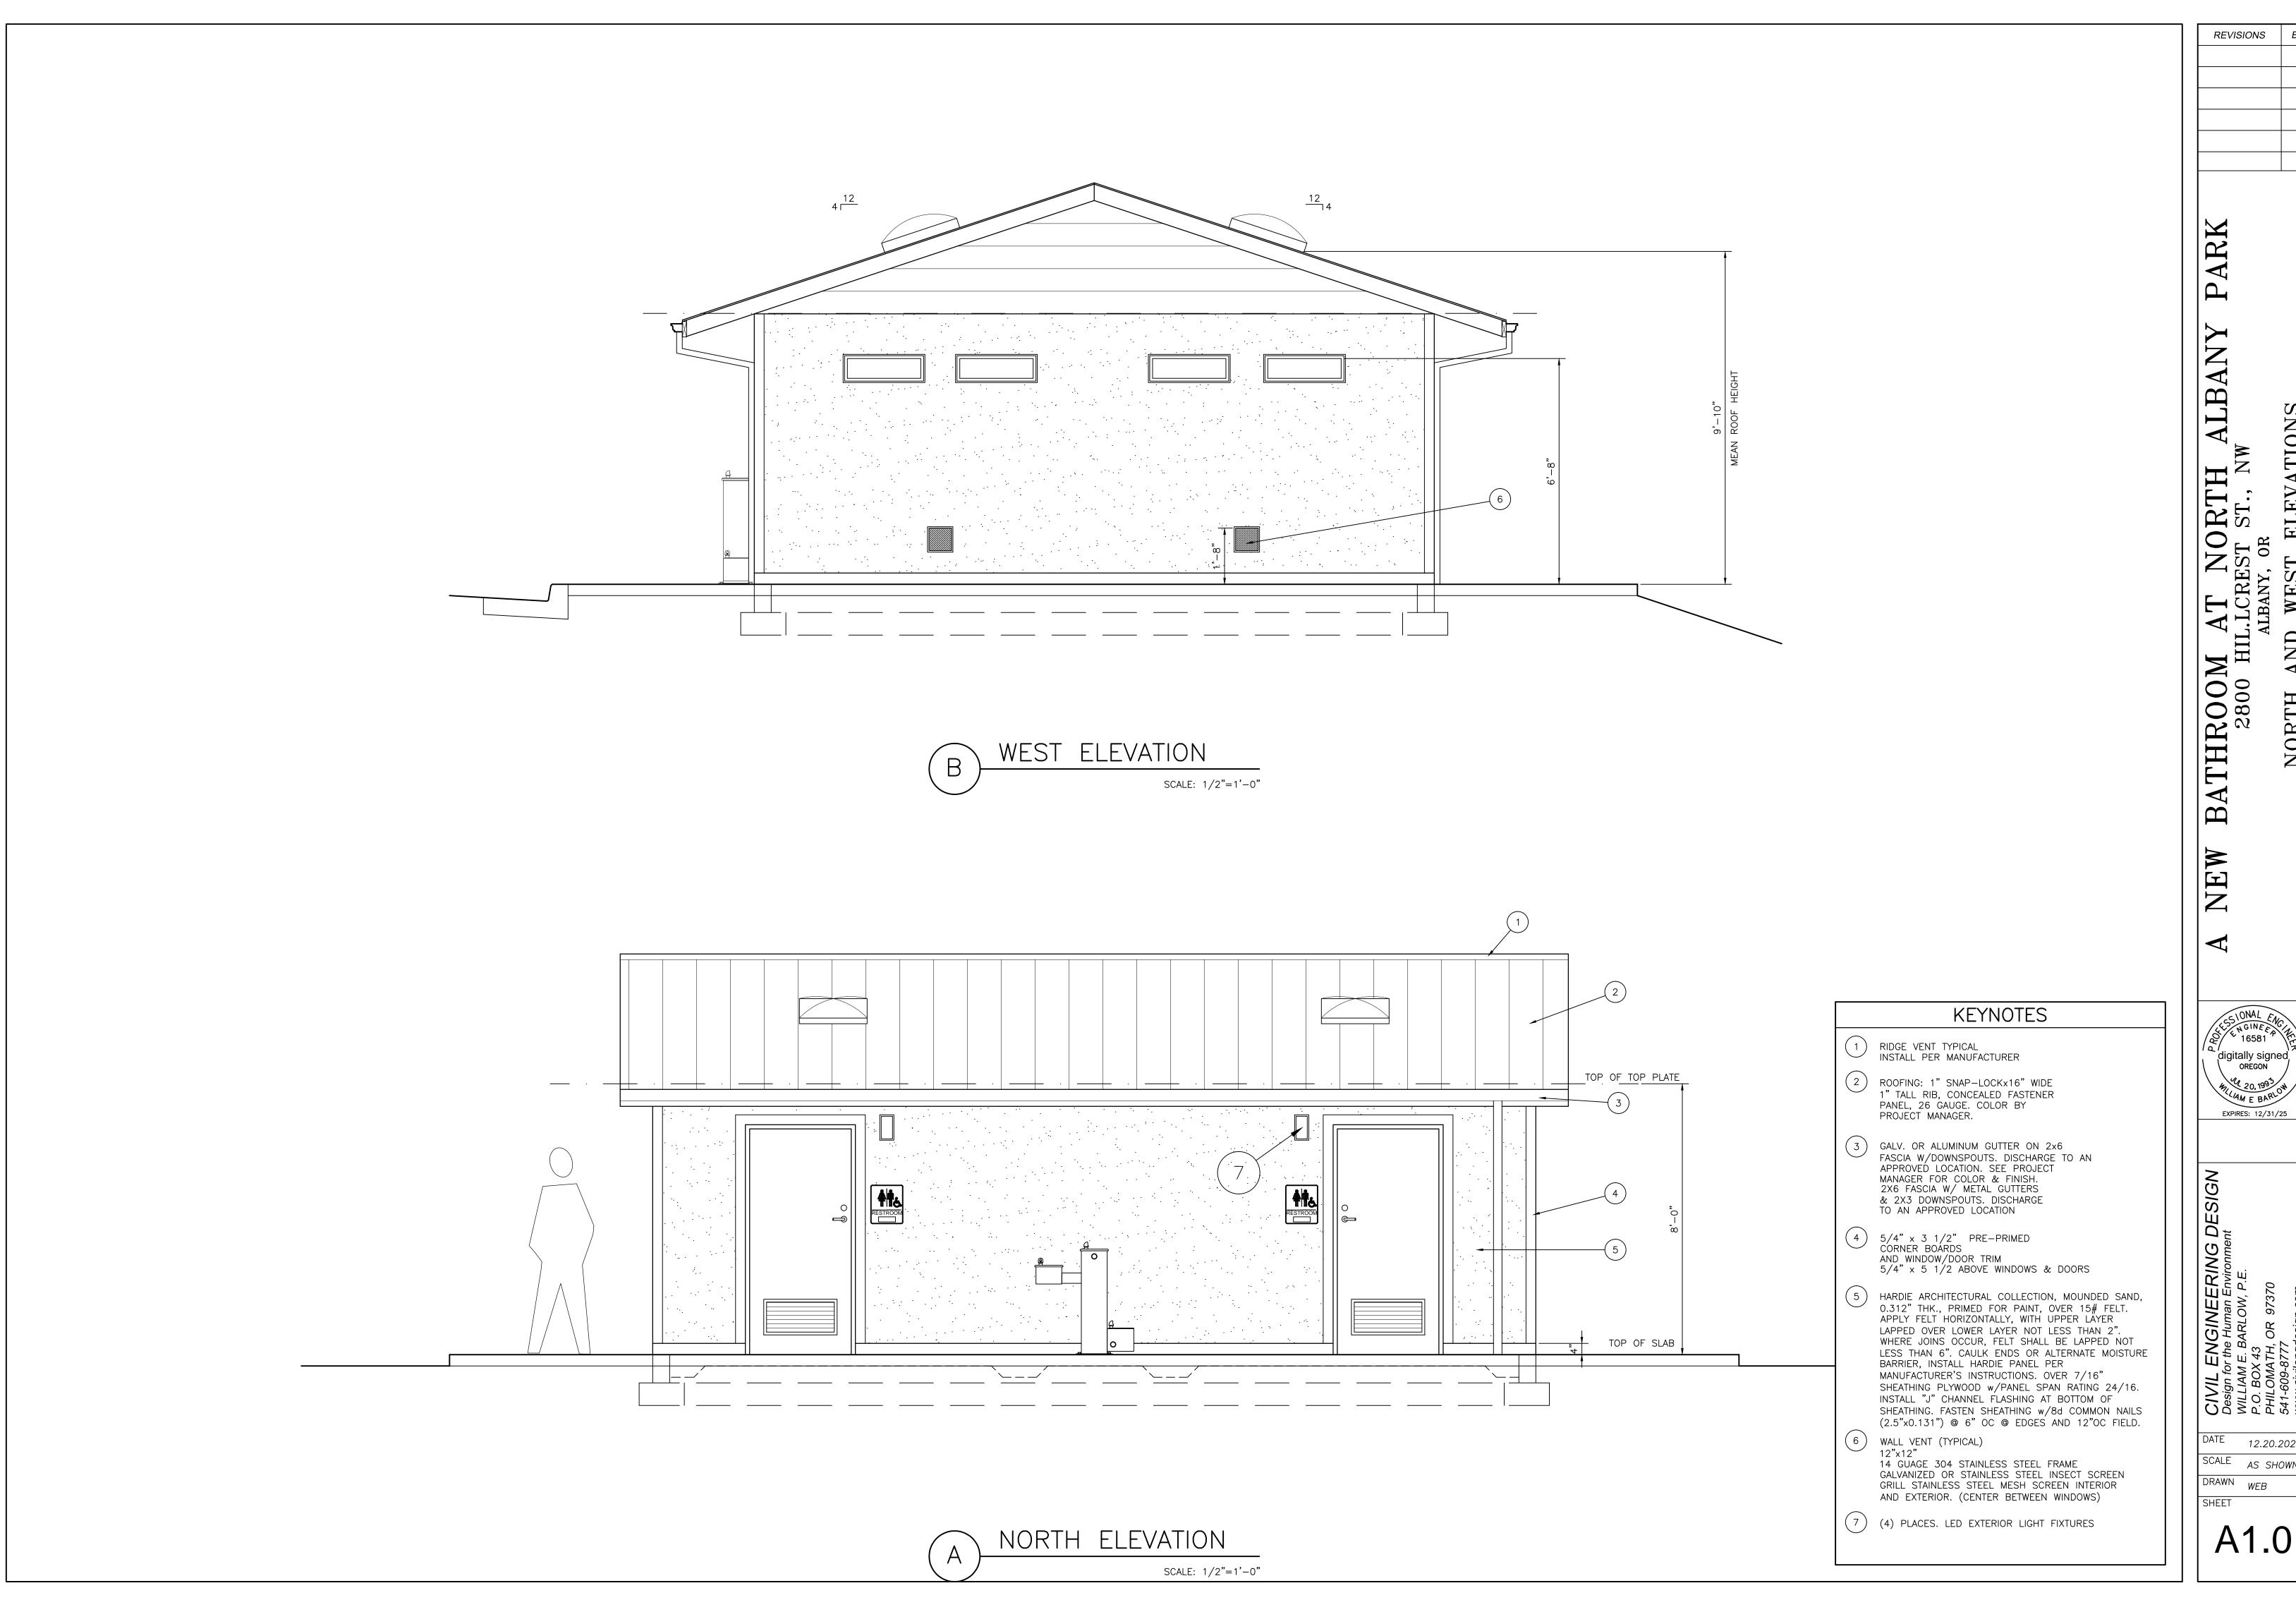

LESS VONAL ENGLANGER 16581 digitally signed, oregon MILIAM E BARL

DATE 12.20.2023 SCALE AS SHOWN DRAWN WEB

A1.0

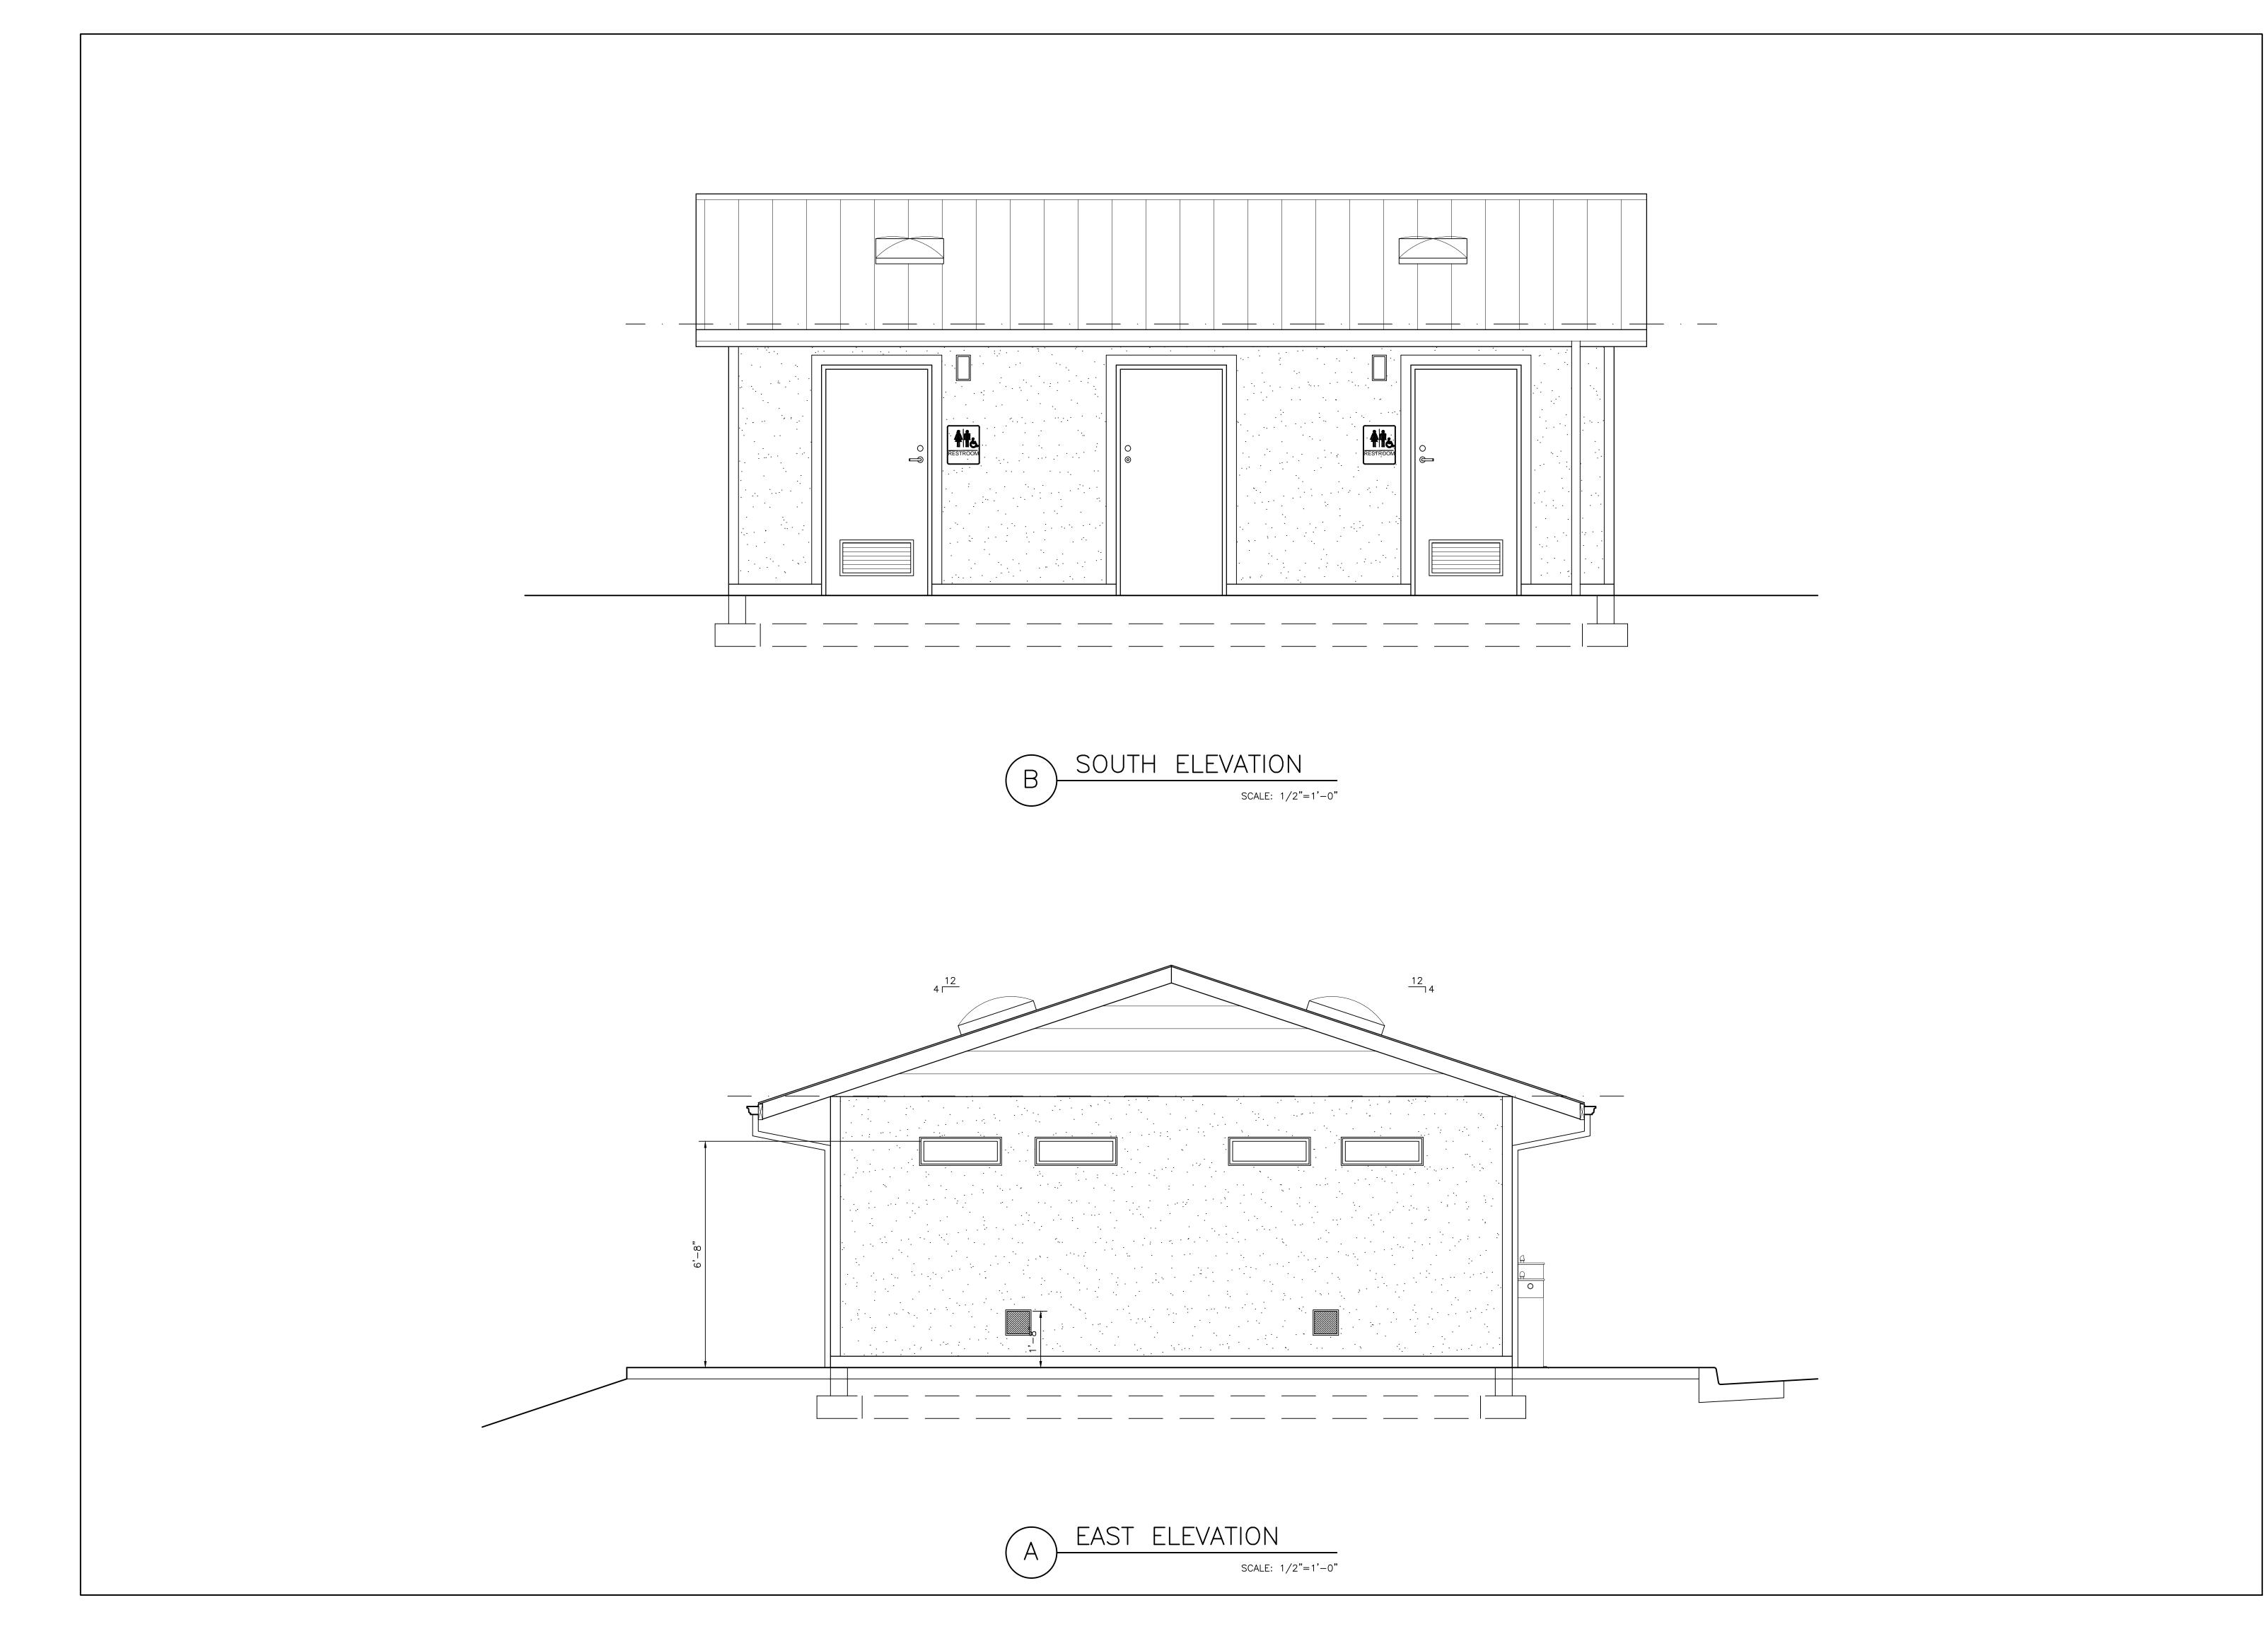

A NEW BATHROOM AT NORTH ALBANY PARK 2800 HIL.LCREST ST., NW ALBANY, OR EAST AND SOUTH ELEVATIONS

REVISIONS

digitally signed oregon

MILLAM E BARLO

EXPIRES: 12/31/25


CIVIL ENGINEERING DESIGN
Design for the Human Environment
WILLIAM E. BARLOW, P.E.
P.O. BOX 43
PHILOMATH, OR 97370
541-609-8777

DATE 12.20.2023

SCALE AS SHOWN

DRAWN WEB

A1.1

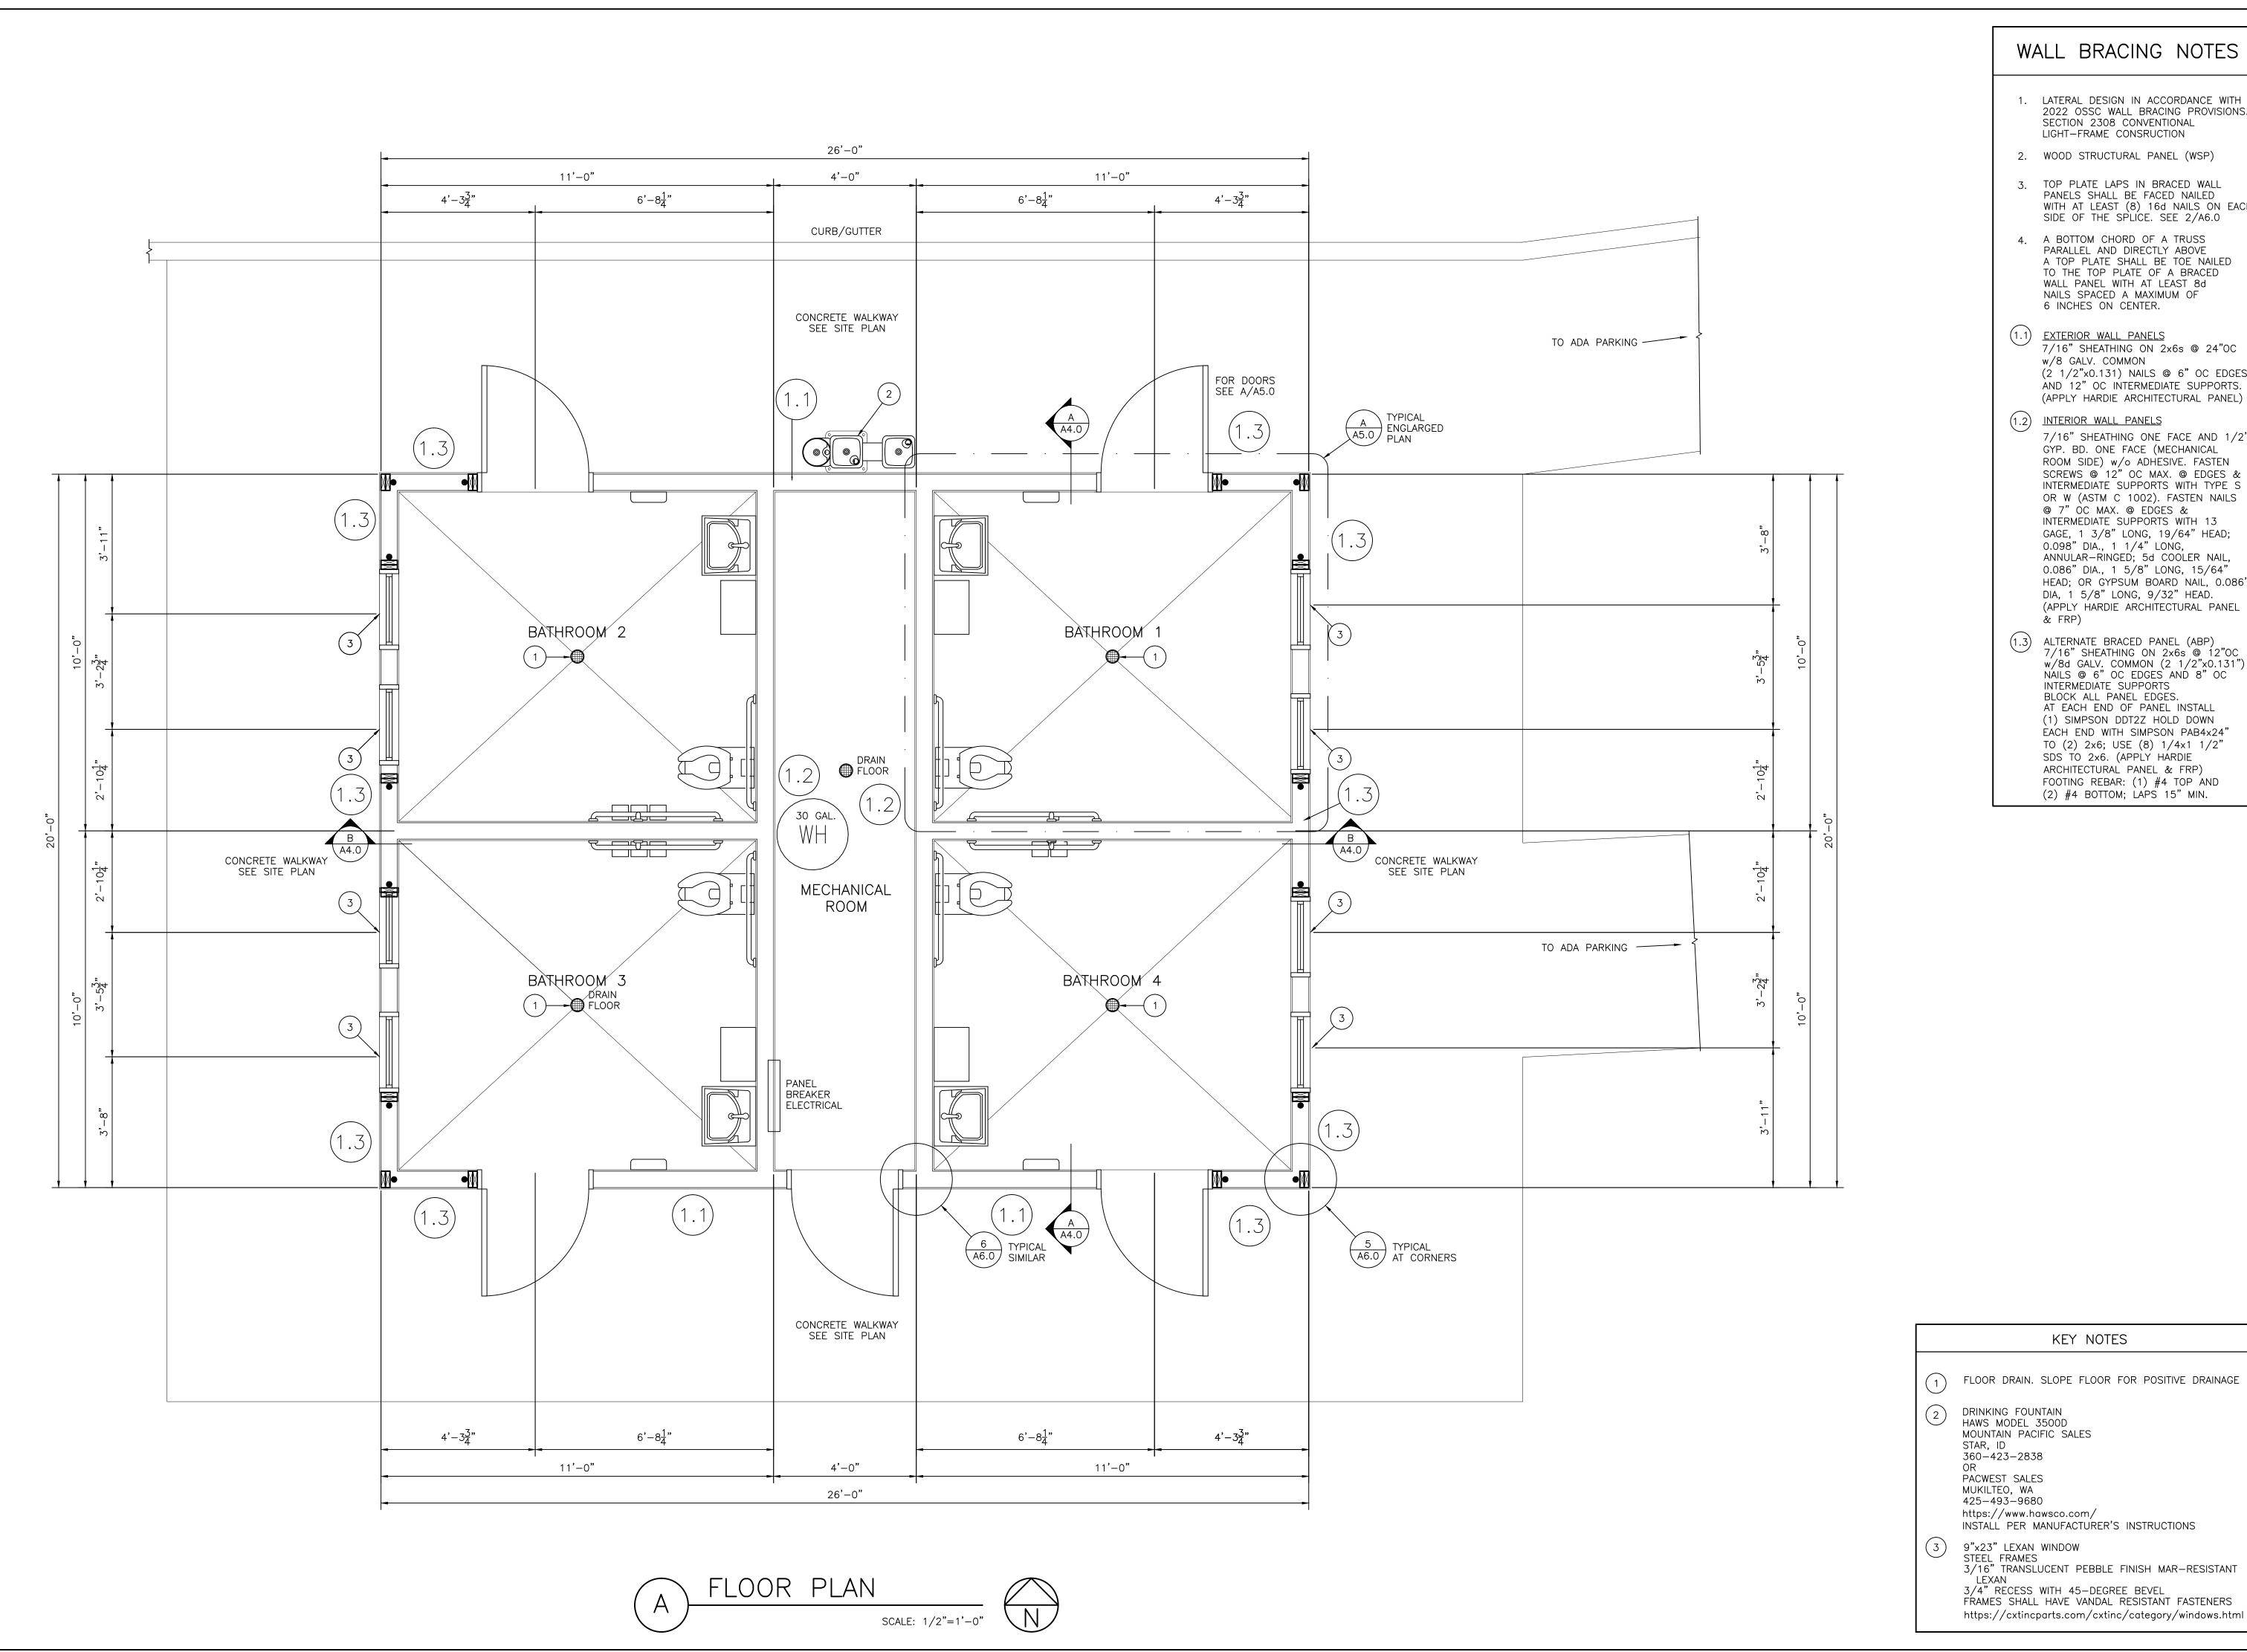

WALL BRACING NOTES

REVISIONS

B

 $\frac{\mathrm{R}00}{2800}$

- 1. LATERAL DESIGN IN ACCORDANCE WITH 2022 OSSC WALL BRACING PROVISIONS. SECTION 2308 CONVENTIONAL LIGHT-FRAME CONSRUCTION
- 2. WOOD STRUCTURAL PANEL (WSP)
- 3. TOP PLATE LAPS IN BRACED WALL PANELS SHALL BE FACED NAILED WITH AT LEAST (8) 16d NAILS ON EACH SIDE OF THE SPLICE. SEE 2/A6.0
- 4. A BOTTOM CHORD OF A TRUSS PARALLEL AND DIRECTLY ABOVE A TOP PLATE SHALL BE TOE NAILED TO THE TOP PLATE OF A BRACED WALL PANEL WITH AT LEAST 8d NAILS SPACED A MAXIMUM OF 6 INCHES ON CENTER.
- (1.1) EXTERIOR WALL PANELS 7/16" SHEATHING ON 2x6s @ 24"OC w/8 GALV. COMMON (2 1/2"x0.131) NAILS @ 6" OC EDGES AND 12" OC INTERMEDIATE SUPPORTS. (APPLY HARDIE ARCHITECTURAL PANEL)
- (1.2) <u>INTERIOR WALL PANELS</u> 7/16" SHEATHING ONE FACE AND 1/2" GYP. BD. ONE FACE (MECHANICAL ROOM SIDE) w/o ADHESIVE. FASTEN SCREWS @ 12" OC MAX. @ EDGES & INTERMEDIATE SUPPORTS WITH TYPE S OR W (ASTM C 1002). FASTEN NAILS @ 7" OC MAX. @ EDGES & INTERMEDIATE SUPPORTS WITH 13 GAGE, 1 3/8" LONG, 19/64" HEAD; 0.098" DIA., 1 1/4" LONG, ANNULAR-RINGED; 5d COOLER NAIL, 0.086" DIA., 1 5/8" LONG, 15/64" HEAD; OR GYPSUM BOARD NAIL, 0.086' DIA, 1 5/8" LONG, 9/32" HEAD. (APPLY HARDIE ARCHITECTURAL PANEL & FRP)
- (1.3) ALTERNATE BRACED PANEL (ABP) 7/16" SHEATHING ON 2x6s @ 12"0C w/8d GALV. COMMON (2 1/2"x0.131") NAILS @ 6" OC EDGES AND 8" OC INTERMEDIATE SUPPORTS BLOCK ALL PANEL EDGES. AT EACH END OF PANEL INSTALL (1) SIMPSON DDT2Z HOLD DOWN EACH END WITH SIMPSON PAB4x24" TO (2) 2x6; USE (8) 1/4x1 1/2" SDS TO 2x6. (APPLY HARDIE ARCHITECTURAL PANEL & FRP) FOOTING REBAR: (1) #4 TOP AND (2) #4 BOTTOM; LAPS 15" MIN.

KEY NOTES

- FLOOR DRAIN. SLOPE FLOOR FOR POSITIVE DRAINAGE
- DRINKING FOUNTAIN HAWS MODEL 3500D MOUNTAIN PACIFIC SALES STAR, ID 360-423-2838 PACWEST SALES


MUKILTEO, WA 425-493-9680 https://www.hawsco.com/ INSTALL PER MANUFACTURER'S INSTRUCTIONS

9"x23" LEXAN WINDOW STEEL FRAMES 3/16" TRANSLUCENT PEBBLE FINISH MAR-RESISTANT 3/4" RECESS WITH 45-DEGREE BEVEL FRAMES SHALL HAVE VANDAL RESISTANT FASTENERS

12.20.2023 SCALE AS SHOWN DRAWN WEB SHEET

EXPIRES: 12/31/25

A2.0

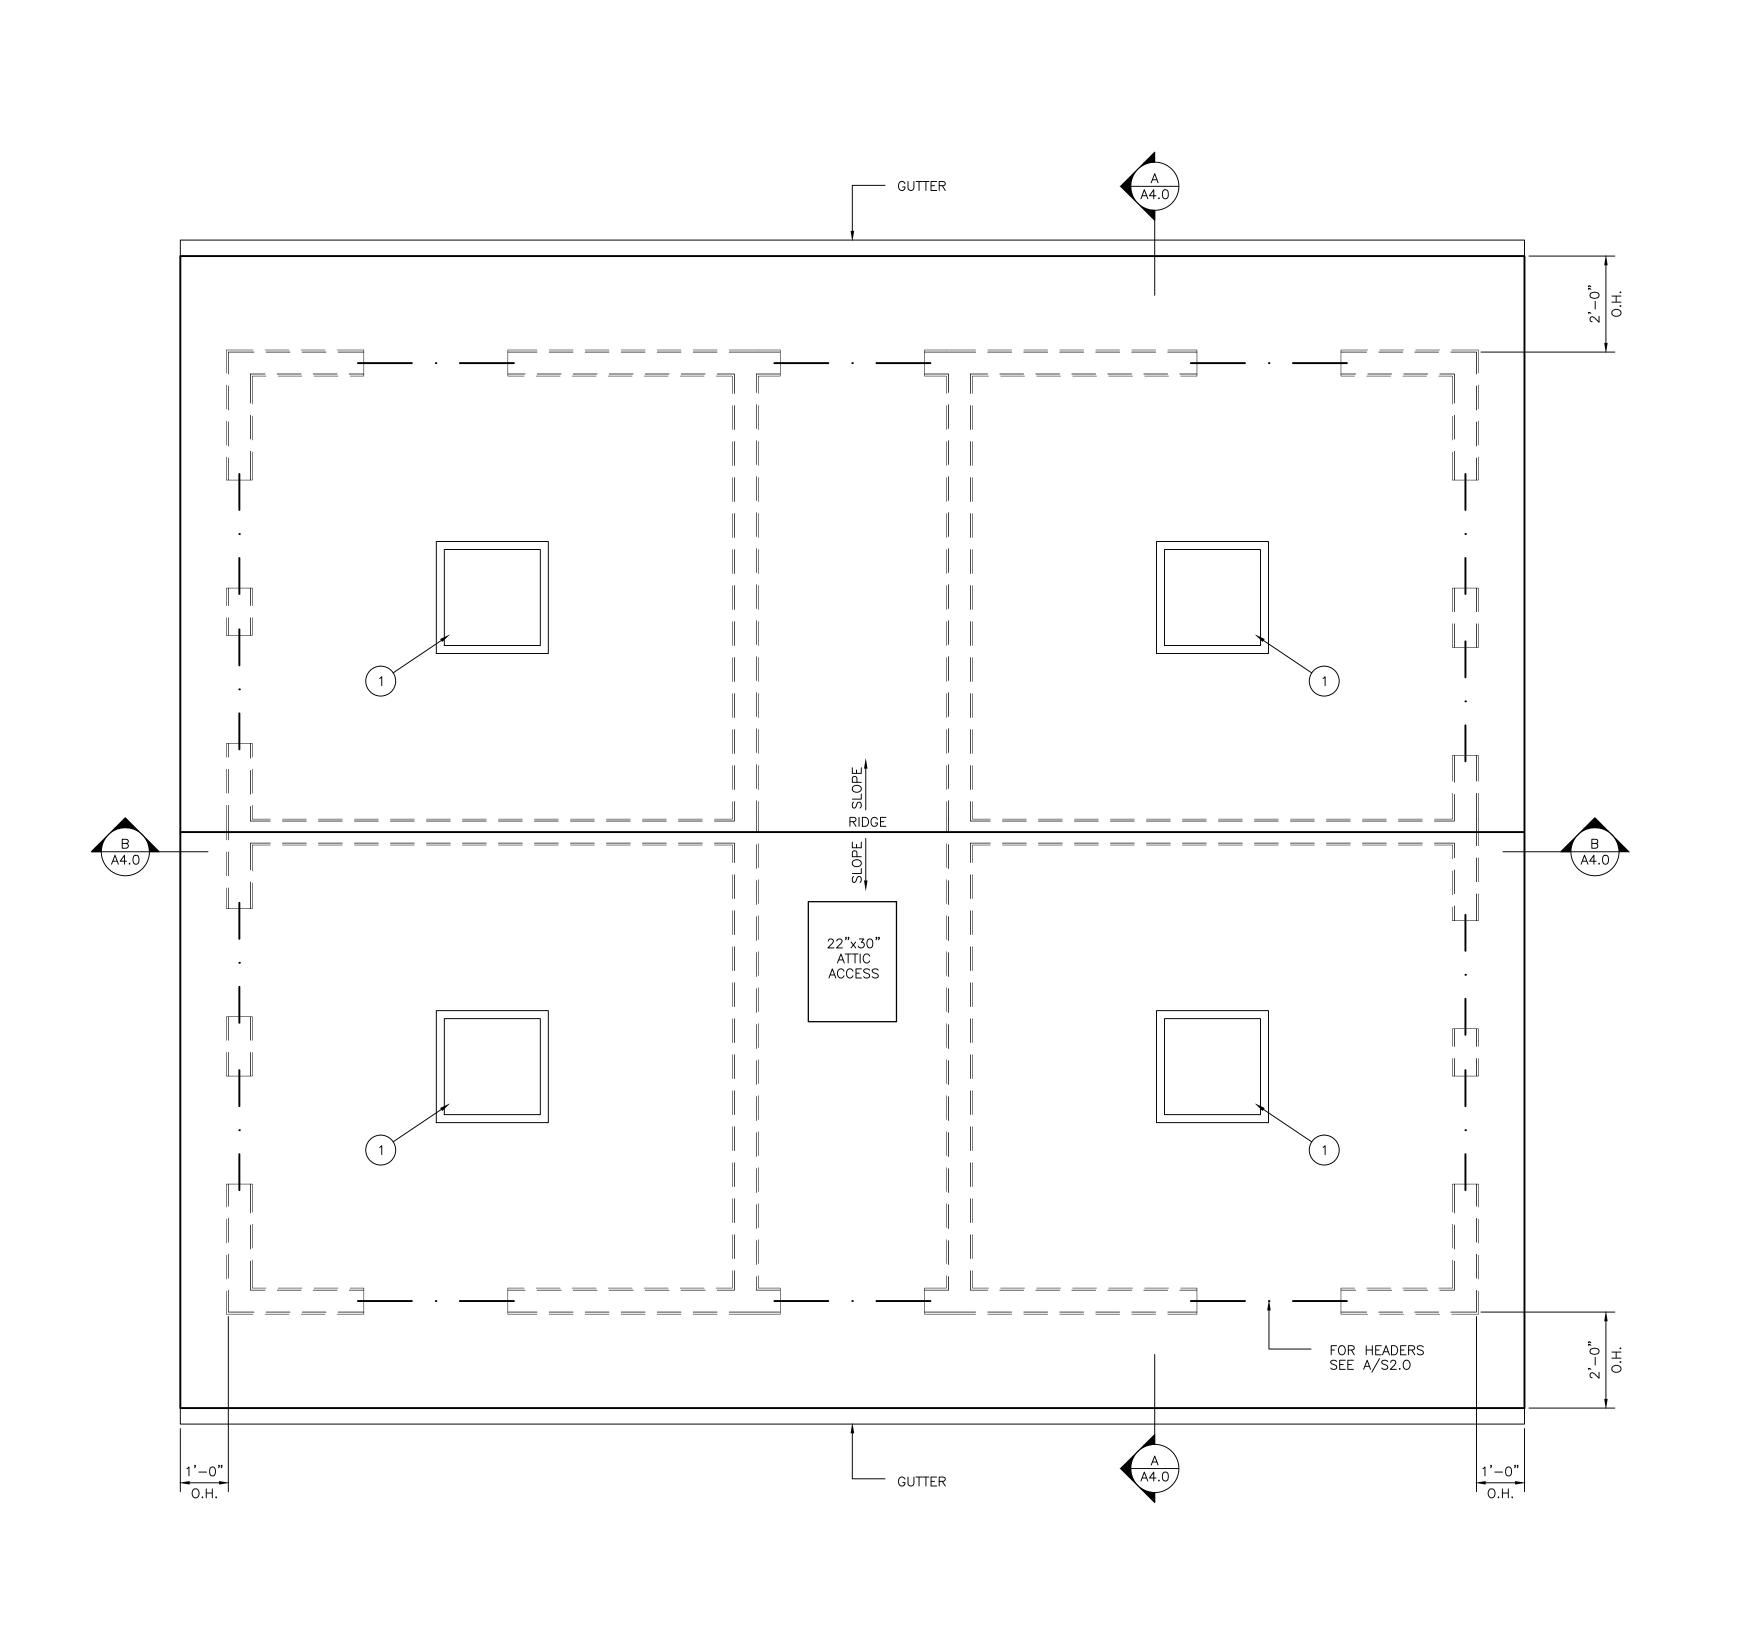

ROOF PLAN

SCALE: 1/2"=1'-0"

BATHROOM AT NORTH 2800 HIL.LCREST ST., N ALBANY, OR ROOF PLAN


digitally signed, oregon EXPIRES: 12/31/25

DATE 12.20.2023 SCALE AS SHOWN DRAWN WEB SHEET

A3.0

KEY NOTES

SKYLIGHT (TYPICAL)
VELUX
MODEL NUMBER: CW3 2828
CURB MOUNT TRIPLE DOME
COMMERCIAL SKYLIGHT
GLAZING CLEAR OVER WHITE
GLAZING CODE: 0A1A2M
VELUX NORTHWEST
FIRCREST, WA
509-565-8808

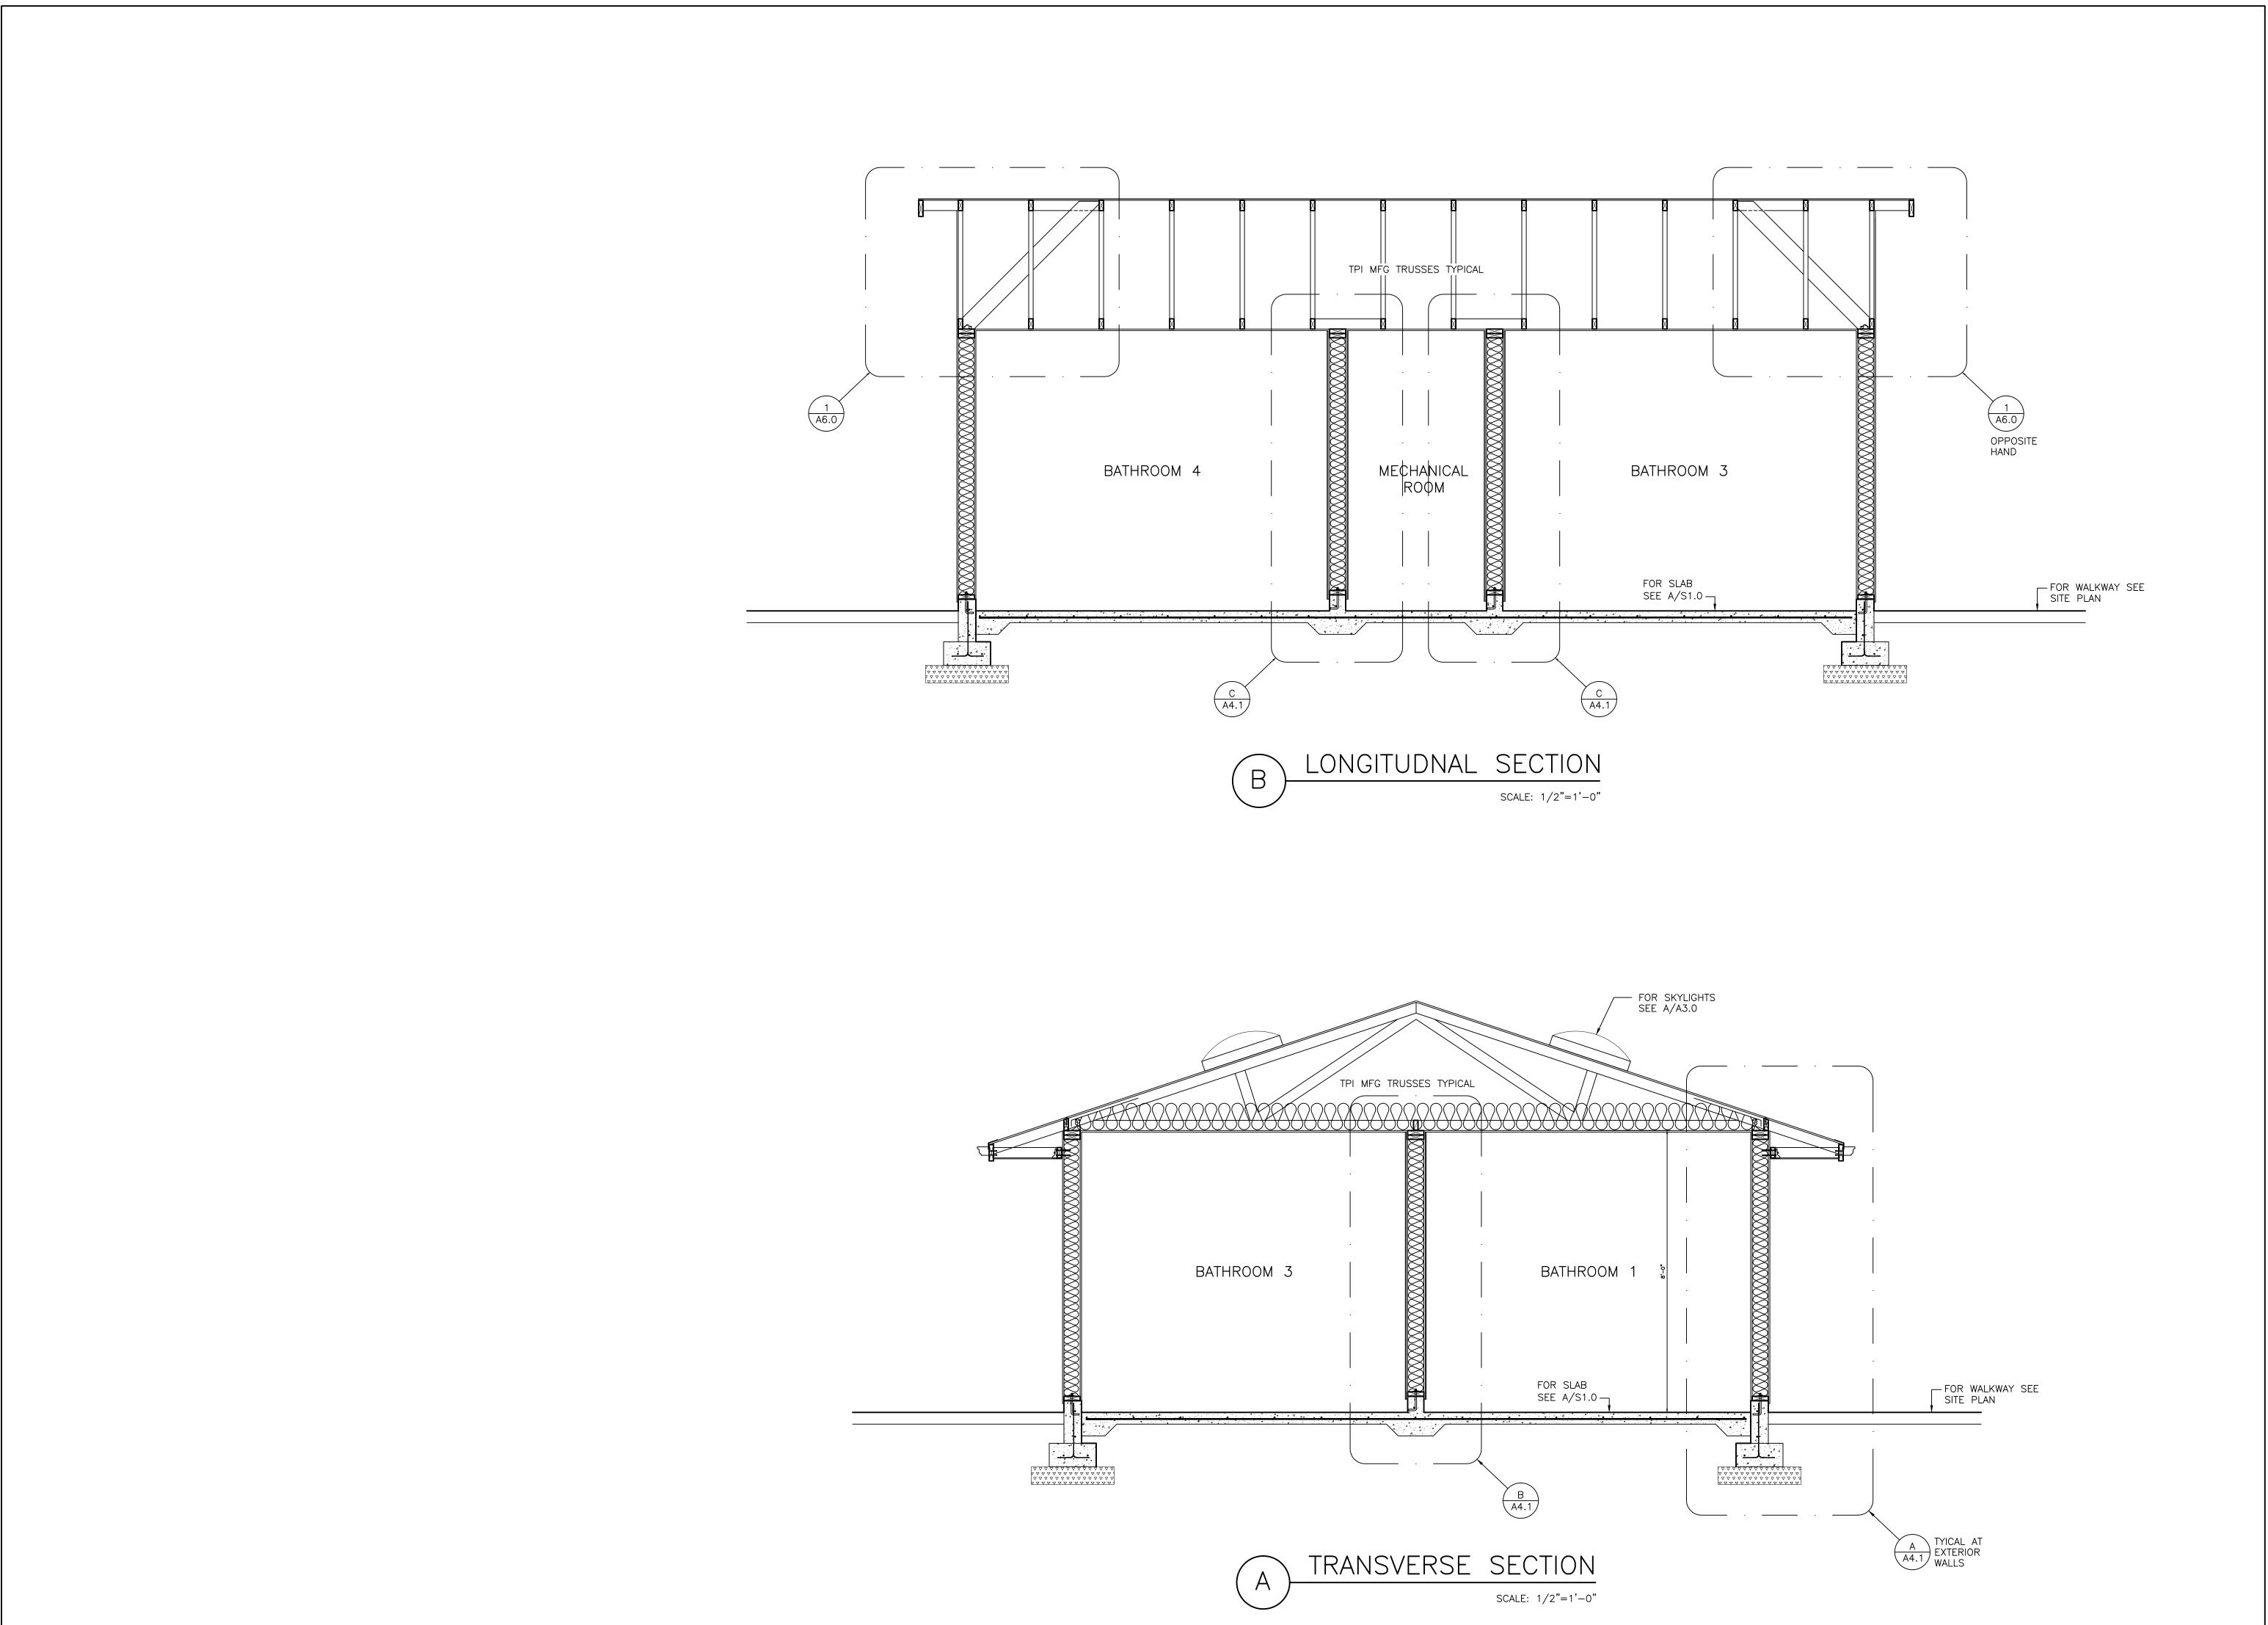

NEW BATHROOM AT NORTH ALBANY PARK
2800 HIL.LCREST ST., NW
ALBANY, OR
TRANSVERSE & LONGITUDNAL SECTIONS

REVISIONS

digitally signed oregon

EXPIRES: 12/31/25

ENGINEERING DESIGN
for the Human Environment

A.E. BARLOW, P.E.

X 43
IATH, OR 97370
-8777

CVIL EN

Design for the

Design for the

WILLIAM E. B

NMLLIAM E. B


P.O. BOX 43

PHILOMATH,

S41-609-877;

www.civilenge

A4.0

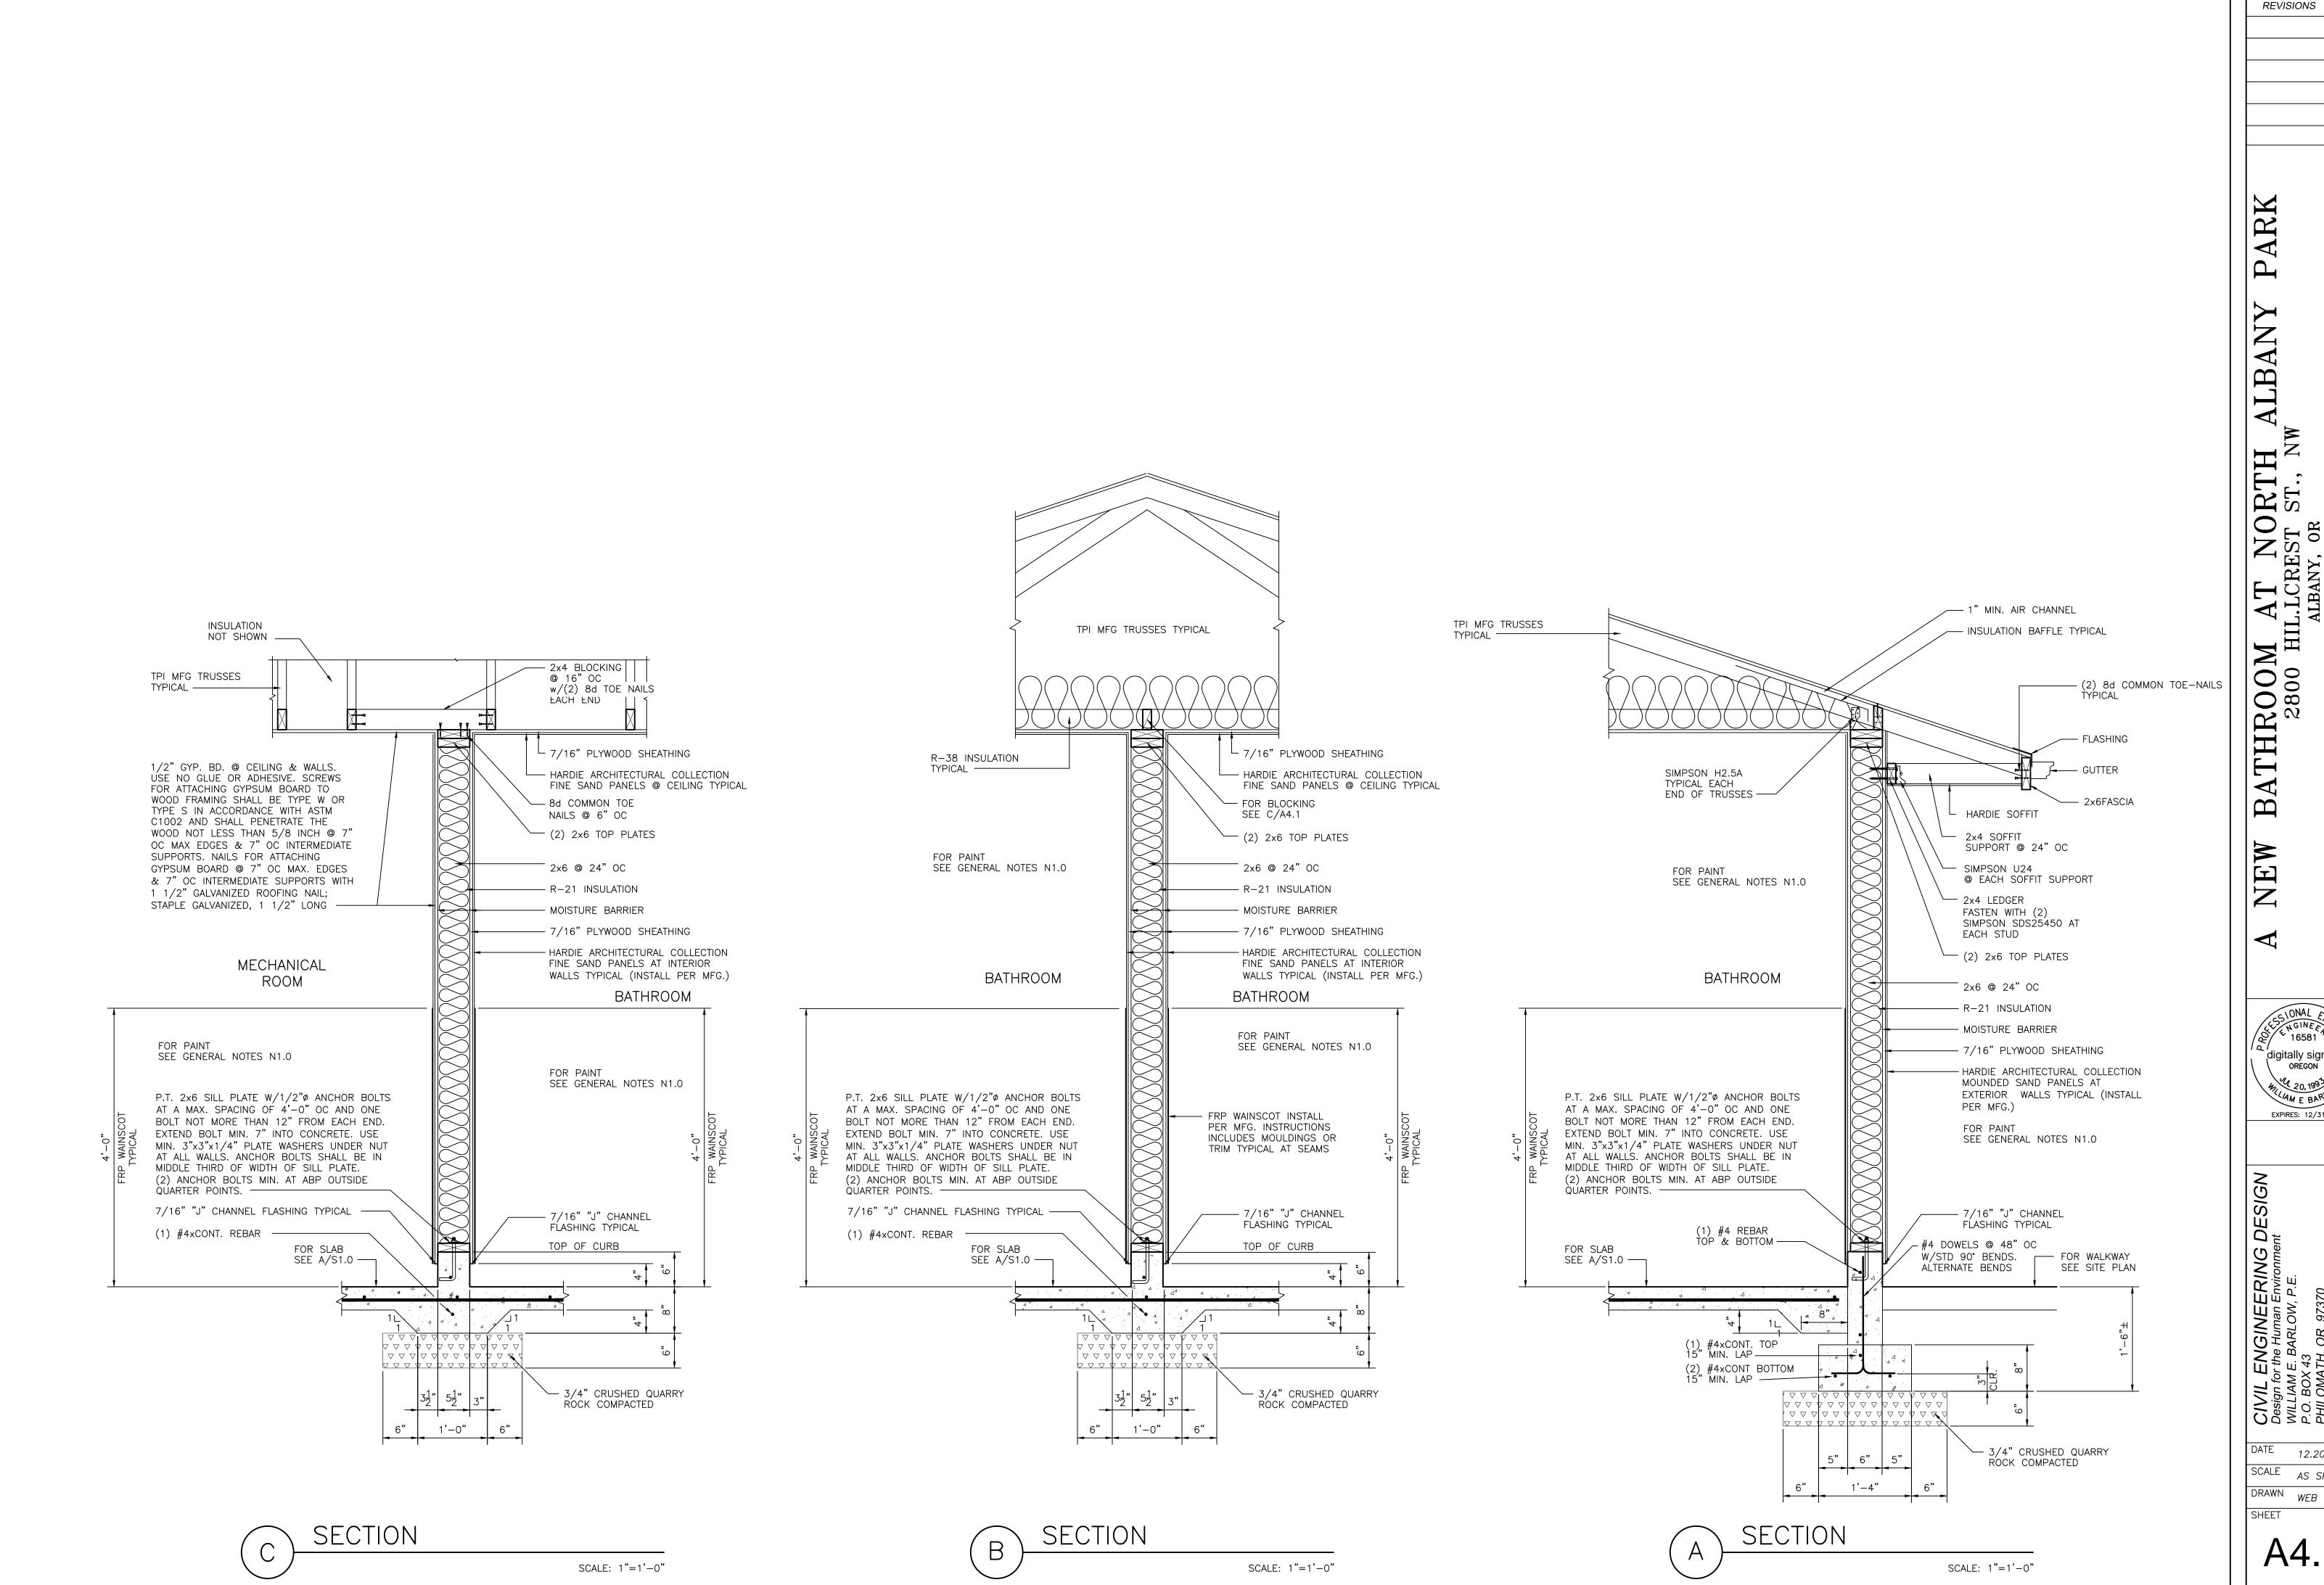


R00] 2800

LESSIONAL ENGLASINE FOR THE 16581 digitally signed oregon 4, 4, 20, 1993 MAM E BARL EXPIRES: 12/31/25

<u>ر</u> ح.

CIVIL EI
Design for th
WILLIAM E.
P.O. BOX 42
PHILOMATH
541-609-877 DATE 12.20.2023 SCALE AS SHOWN DRAWN WEB

A4.

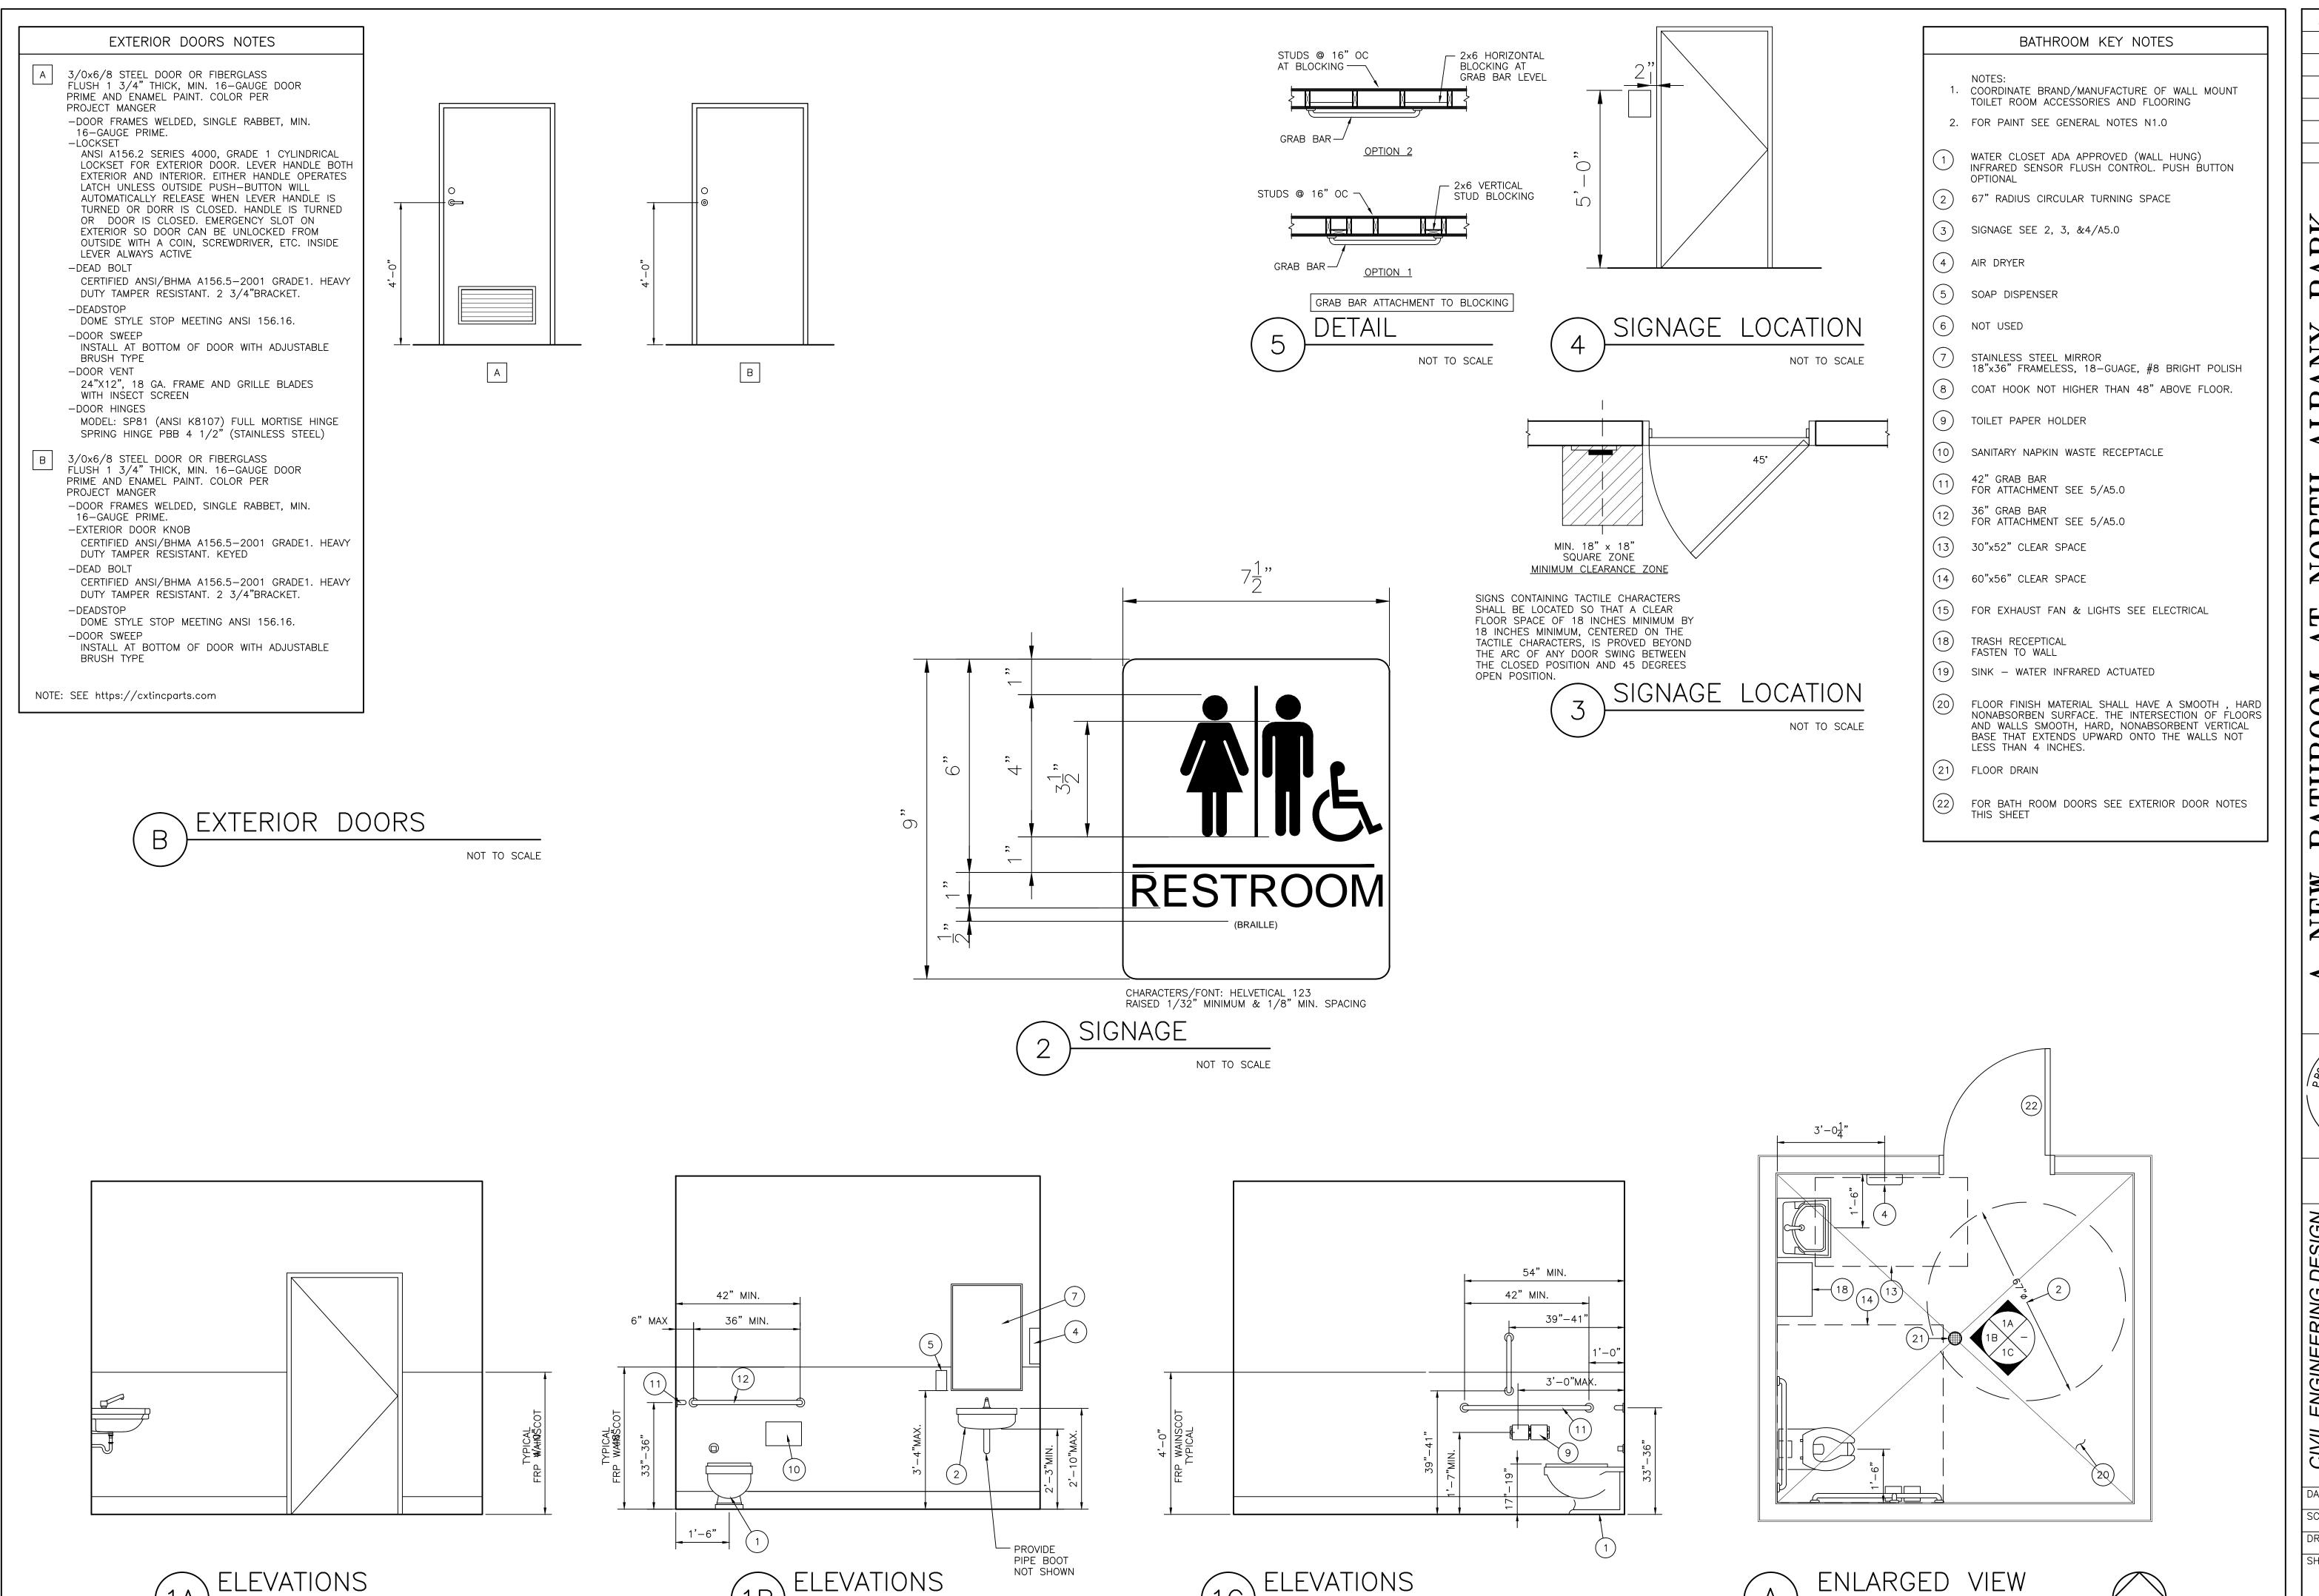

SCALE: 1/2"=1'-0"

SCALE: 1/2"=1'-0"


SCALE: 1/2"=1'-0"

REVISIONS

EXPIRES: 12/31/25

12.20.2023 SCALE AS SHOWN DRAWN WEB

A5.0

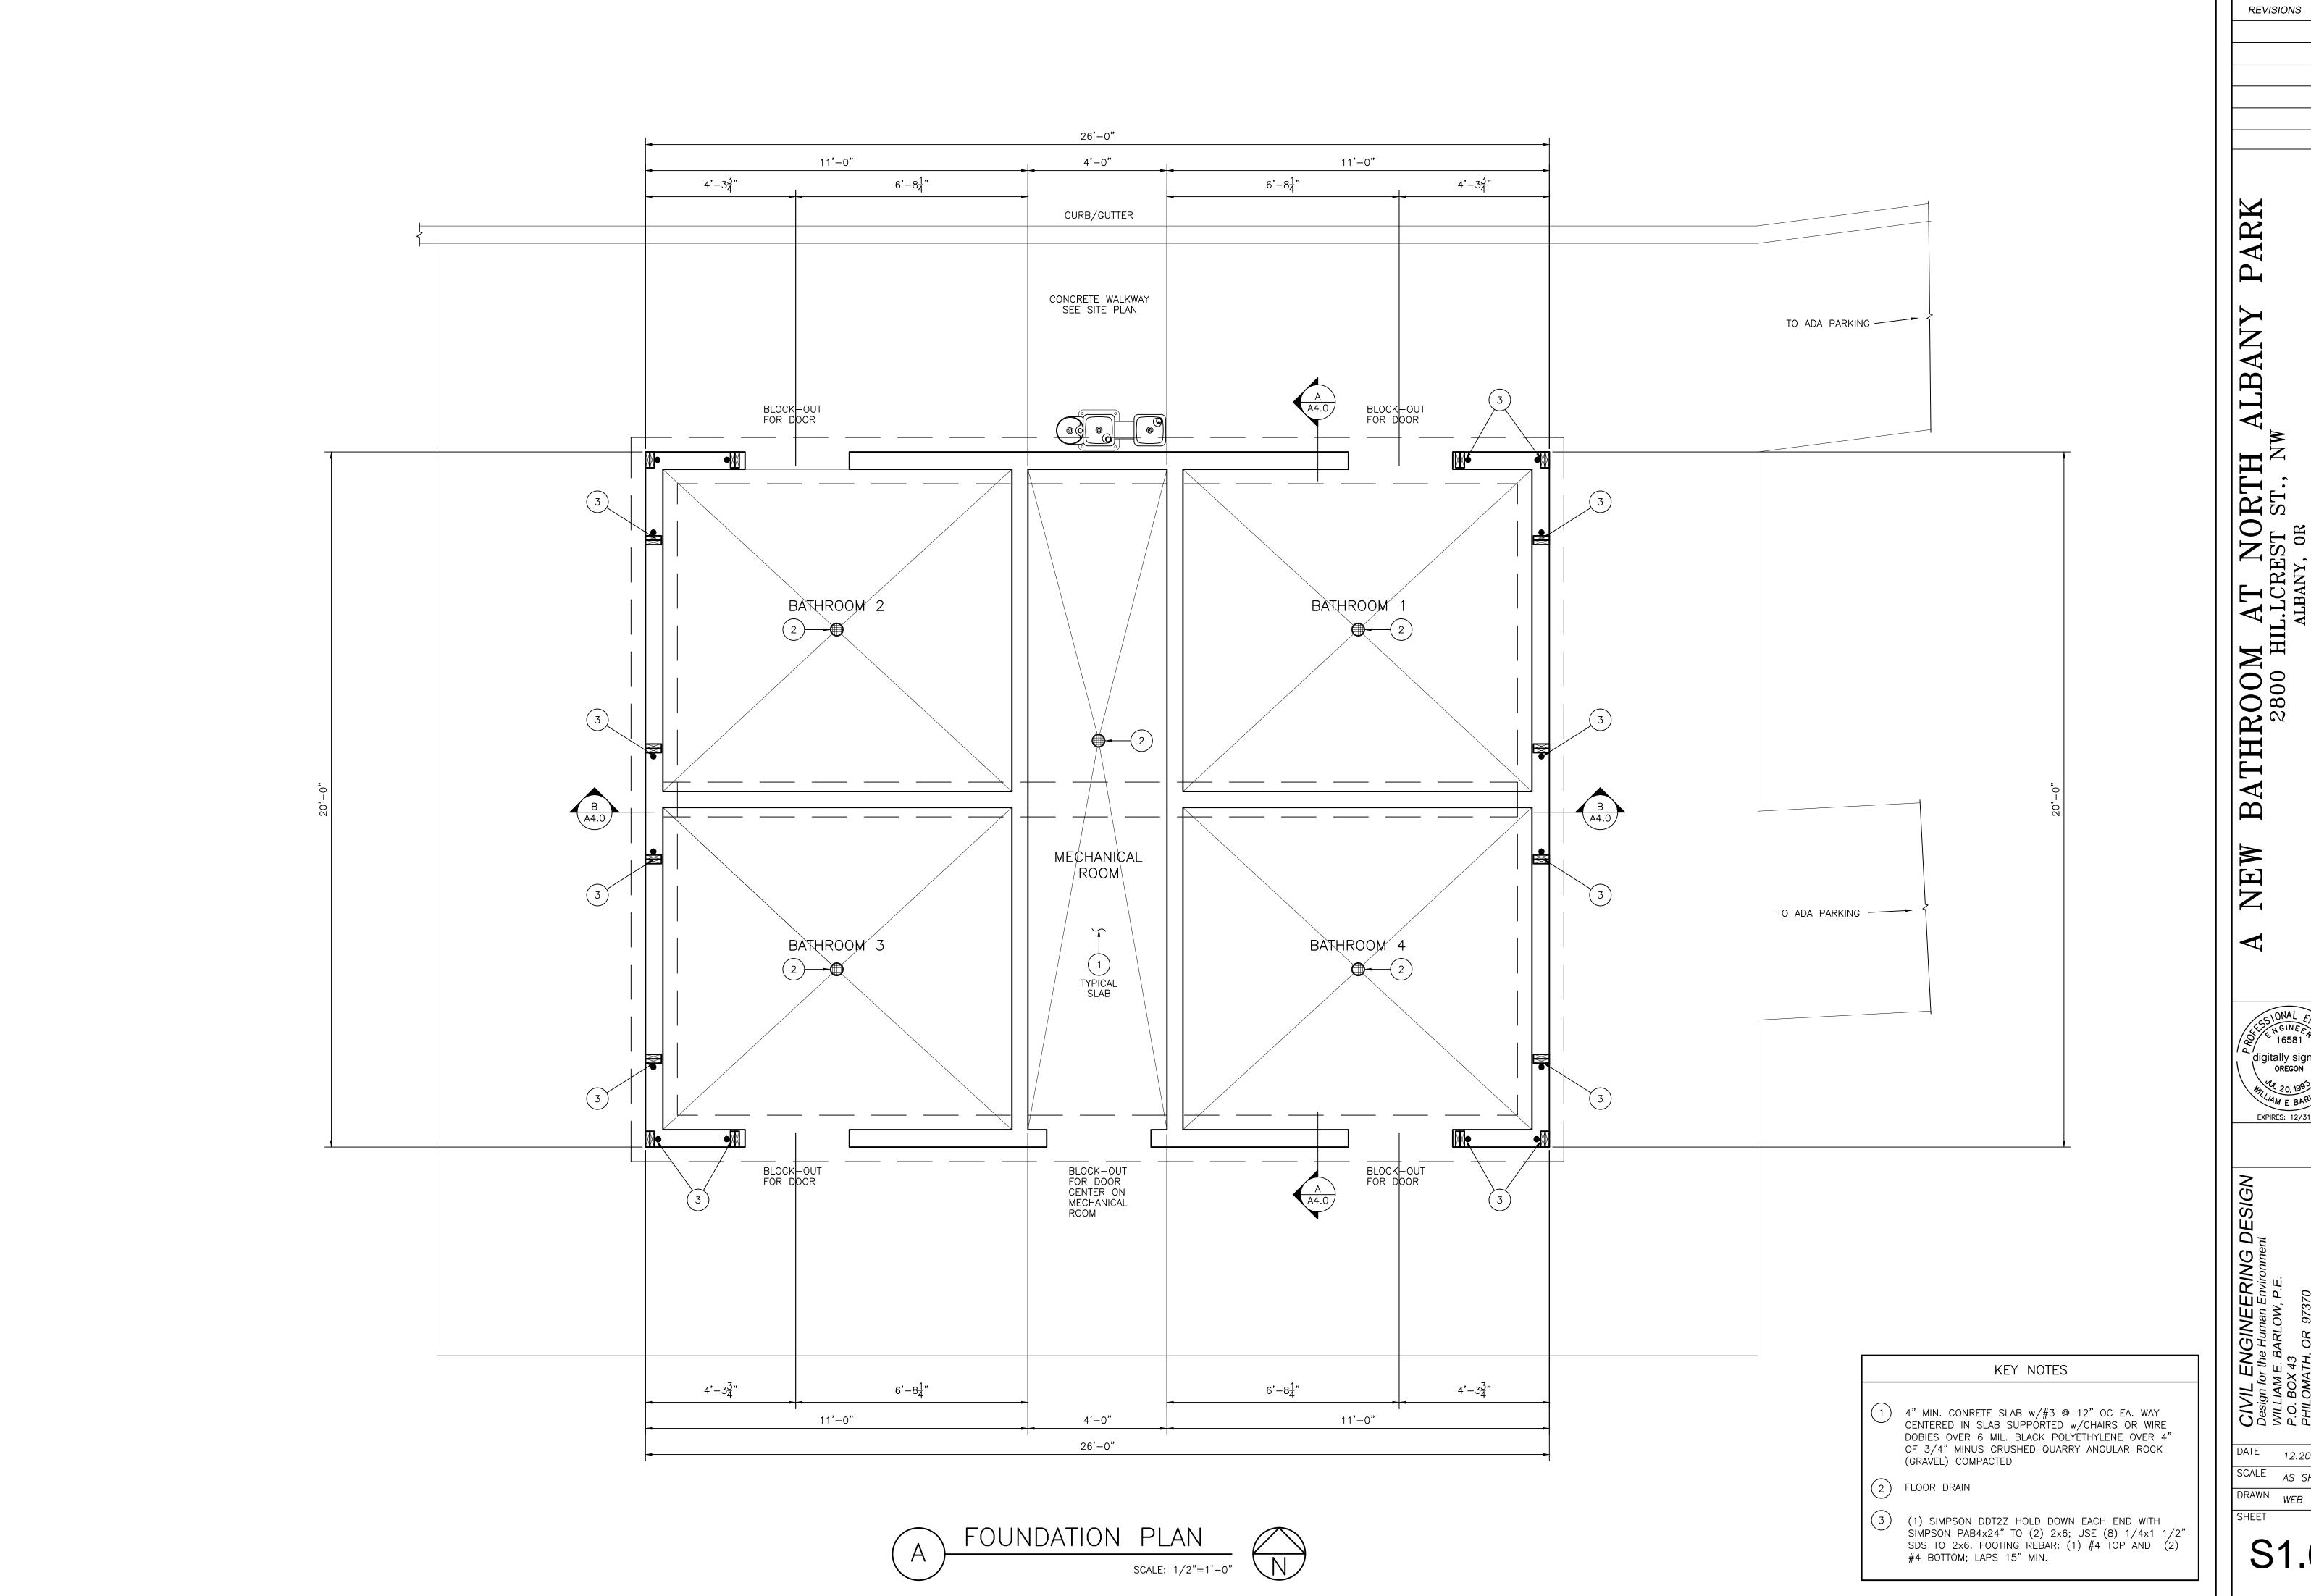


EXPIRES: 12/31/25

DATE 12.20.2023

SCALE AS SHOWN DRAWN WEB

S1.0

REVISIONS KEY NOTES (2) 2x6 ON EDGE. NAIL—LAM w/(2) ROWS 8d COMMON (3"x0.131") NAILS AT 12" OC, 1" FROM EDGES AND (2) NAILS 6" FROM EACH END.

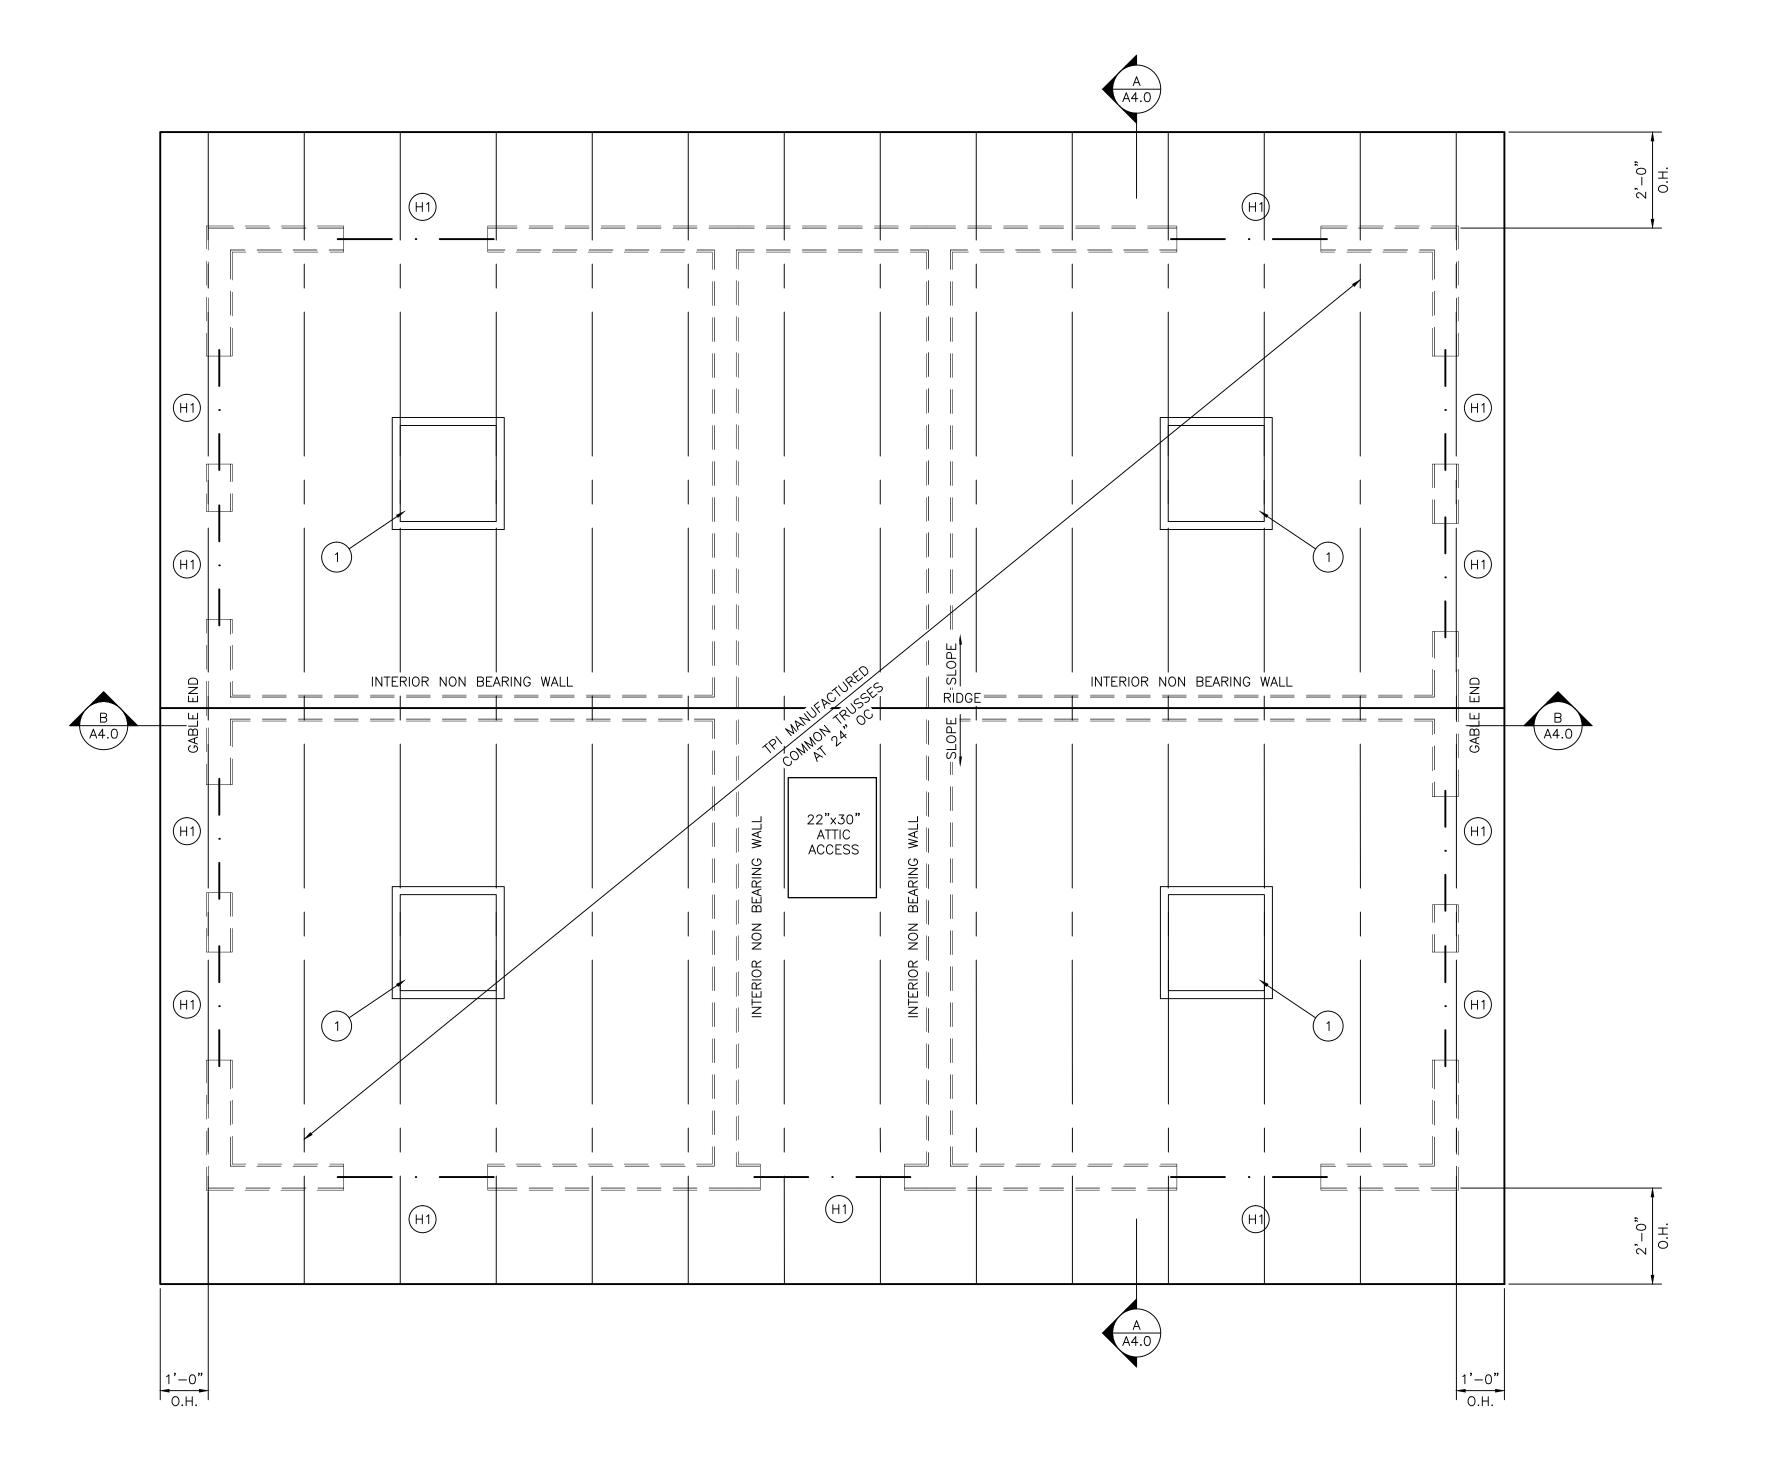

ROOF PLAN

SCALE: 1/2"=1'-0"

KEY NOTES

SKYLIGHT (TYPICAL) VELUX

MODEL NUMBER: CW3 2828
CURB MOUNT TRIPLE DOME
COMMERCIAL SKYLIGHT
GLAZING CLEAR OVER WHITE
GLAZING CODE: 0A1A2M
VELUX NORTHWEST FIRCREST, WA 509-565-8808

digitally signed oregon EXPIRES: 12/31/25

CIVIL ENGINEERING L
Design for the Human Environment
WILLIAM E. BARLOW, P.E.
P.O. BOX 43
PHILOMATH, OR 97370
541-609-8777

DATE 12.20.2023 SCALE AS SHOWN DRAWN WEB

SHEET